



A11106 979655

NBS
PUBLICATIONS


NBSIR 82-2634

Workshop on Combustion Product Toxicity Summary of Presentations, September 10, 1982

U.S. DEPARTMENT OF COMMERCE
National Bureau of Standards
National Engineering Laboratory
Center for Fire Research
Washington, DC 20234

November 1982

Issued January 1983



QC
100
.U56
82-2634
1982
C.2

DEPARTMENT OF COMMERCE
NATIONAL BUREAU OF STANDARDS

JAN 19 1983

not on file - 870
C-10
U.S. 82-2634
10

NBSIR 82-2634

**WORKSHOP ON COMBUSTION PRODUCT
TOXICITY SUMMARY OF PRESENTATIONS,
SEPTEMBER 10, 1982**

J. E. Snell, B. C. Levin, A. J. Fowell

U.S. DEPARTMENT OF COMMERCE
National Bureau of Standards
National Engineering Laboratory
Center for Fire Research
Washington, DC 20234

November 1982

Issued January 1983

U.S. DEPARTMENT OF COMMERCE, Malcolm Baldrige, *Secretary*
NATIONAL BUREAU OF STANDARDS, Ernest Ambler, *Director*

Workshop on Combustion Product Toxicity
Summary of Presentations
September 10, 1982

J. E. Snell, B. C. Levin, A. J. Fowell

FOREWORD

This publication is a summary of presentations given September 10, 1982, at a Workshop on Combustion Product Toxicity.

Publicity on fire deaths caused by smoke and toxic gases has given impetus to a number of state legislatures to consider requiring material toxicity provisions in building codes and other regulations. The National Bureau of Standards recently published a technical report describing the development of a test method for the assessment of the acute inhalation toxicity of combustion products. This test method is intended primarily for research and; for preliminary screening purposes by product researchers and material manufacturers in developing and evaluating materials. The test method is not intended to be used by itself in evaluating the suitability of a material for specific application since additional factors must be considered.

Nonetheless, a number of fire, building code, and other regulatory officials, as well as industry and association members, who have responsibilities relating to fire hazard assessment may benefit from learning more about the test method, the background to its development, and limitations on its appropriate use, and the relevance of this work to code, regulatory, or material selection decisions or provisions.

Therefore, the National Bureau of Standards sponsored a half-day workshop on combustion product toxicity, 9:00 a.m. - 12:00 noon, Friday, September 10, 1982, at NBS in Gaithersburg, Maryland. The purpose of this workshop was to brief fire code and building officials and others on the NBS test method for assessing acute inhalation toxicity of combustion products and to provide an opportunity for discussion of its appropriate use.

The agenda of the workshop is presented on page v. The presentations are published here in the order they appear on the agenda.

TABLE OF CONTENTS

	<u>Page</u>
FOREWORD	iii
AGENDA	v
PRESENTATIONS:	
"Fire Hazard Assessment and Combustion Product Toxicity--An Overview of the Context", Jack E. Snell	1
"NBS Protocol/Test Method for Assessment of the Acute Inhalation Toxicity of Combustion Products", Barbara C. Levin.	13
"Hazard Assessment--Review of Research in Progress and Planned", Andrew J. Fowell.	35
APPENDIX - ATTENDANCE LIST	57

WORKSHOP ON COMBUSTION PRODUCT TOXICITY

National Bureau of Standards
Green Auditorium

September 10, 1982

AGENDA

9:00	Welcome to NBS	Samuel Kramer Deputy Director-Programs National Engineering Lab
9:10	Fire, Hazard Assessment & Combustion Product Toxicity -- An Overview of the Context	Jack E. Snell, Director CFR
9:30	NBS Protocol/Test Method for Assessment of the Acute Inhalation Toxicity of Combustion Products	Barbara C. Levin, Head Fire Toxicology, CFR
10:10	Coffee Break	
10:30	Hazard Assessment -- Review of Research in Progress and Planned	Andrew J. Fowell, Chief Fire Safety Technology Division, CFR
11:15	Question & Answer Session	Jack E. Snell - Moderator
12:00	Adjourn	

Fire Hazard Assessment and Combustion Product
Toxicity--An Overview of the Context
Jack E. Snell

Good morning ladies and gentlemen. It's a pleasure for me to have the opportunity to discuss this important topic with you. I'm advised I should say at the very outset that our presentations are being video taped and the questions and answers recorded so that we can make this information available to others.

I've labored a great deal over how to begin this morning's program and have concluded it would be most fitting to begin with the "answer" or the "bottom line" as we see it and then successively through the balance of the program fill in and elaborate in detail. The purpose of this workshop is to provide interested parties in the fire community in general and particularly building and regulatory code officials a progress report on the Center for Fire Research's work in combustion product toxicity. Specifically, we wish to clear the air of any question or misunderstanding concerning NBSIR 82-2532 entitled, "Further Development of a Test Method for the Assessment of the Acute Inhalation Toxicity of Combustion Products," a copy of which you all now have.

And now here it comes, this is what we see as the bottom line. The test method described in this report is primarily intended for research and preliminary screening purposes for use by product researchers and material manufacturers in developing and evaluating materials. It is not suitable for use by itself for evaluating the fire safety of materials in use since a number of additional factors must be considered in a specific situation. Note the words "further development" in the title of this report. This simply denotes the fact that this is not the first and certainly is not the last report or word from us on this topic. Further development and evaluation of this test method and, in our view, all others currently available is necessary to determine their suitability or utility for regulatory purposes presuming the intent there of course, is fire-safe material/product design, selection, or evaluation.

Please don't be misled by these remarks. We are concerned about combustion product toxicity. However, we are much more intent upon broadening our understanding of *all the principal determinants of the real threats or hazards posed by fire and the development of practicable tools for your use in dealing with them.* It's our view that it will be mutually beneficial to share with those of you in the regulatory community as well as those in industry, our thinking on the technical issues that remain to be resolved regarding combustion product toxicity in the broader context of fire hazard assessment, and our current and planned research on these topics. Thus, even though we make no claim of offering a complete or easy solution to your current problems, we do believe this information will be of practical use to you, now.

Therefore, it is our hope that each of you will leave this meeting with a number of things. First, a clear understanding of what the test method is, what it does and does not address, our views on its appropriate use, and a copy of NBSIR 82-2532. Further, we hope you'll have a clear understanding of our plans for future research in this area. Also, we hope to answer your questions. If we don't answer them this morning, we'll be sure to get the answers to you. Finally, we have asked each of you to fill out a registration card. It's our intent to send each of you a brief summary of the presentations of this morning for your further reference and also a list of all the folks here with their affiliation for your use and reference in getting the further information you may need to address the question of hazard assessment in a specific design problem or context.

For our part we hope to gain from this meeting a clear perception of the technical and measurement needs and concerns that you have so that to the extent possible within our resource limitations our efforts are responsive to them.

Center for Fire Research Role in Combustion Toxicity Research

The National Bureau of Standards has been involved in fire research from its very beginning. The Fire Prevention and Control Act of 1974 clearly dictated that the focus of the Center for Fire Research should be

on developing greater understanding of fire phenomena, and providing the scientific and technical basis for development of sharper tools for resolving the serious problem of fire in this country. From that time we have been involved in combustion toxicity related work. This continued through the efforts of the Product Research Committee in which we worked with a number of groups in industry to broaden our understanding of materials' fire properties in general and toxicity in particular. In September 1980 we published a preliminary toxicity test method that subsequently was used in an interlaboratory evaluation and led to the development of the report we'll be discussing this morning. This effort has involved a large number of people. In fact, I'd venture to guess somewhere between 1/2 to 2/3 of those here this morning have been involved one way or another in the work we are talking about.

The topic of toxicity of combustion products from fires has been a matter of a great deal of publicity recently and indeed a matter of genuine concern within the fire community for quite sometime. For example, the National Fire Protection Association, and the National Institute of Building Sciences have recently held extensive meetings on this topic and have commissioned special task forces to review the facts and generate action recommendations for the fire community at large. In recent months a number of states have conducted hearings concerning the possible need for regulatory measures to address toxicity concerns. These include New York, New Mexico, and California. Also, CPSC and other federal agencies have expressed similar concerns regarding certain products and furnishings. Our intent this morning is not to attempt to replicate these efforts or to offer you a simple solution to the whole toxicity problem, but rather to provide a perspective on our scientific and technical efforts that may be useful to you in developing a lasting solution to this particular problem.

Fire Hazard Assessment

Now, let me say a few words about the context in which we see the toxicity issue. Firstly, and most importantly, fire safety usually involves tradeoffs (slide 1*). It's not a matter of safety at any cost. If that were

*Slides follow each presentation.

the case, we'd all be wearing glass clothing and living in stone shelters as John Lyons is fond of saying. Rather, it's a matter of trade-offs between *function, safety* and *cost*. These trade-offs are made typically in the marketplace and in the governmental or regulatory contexts. For example, one of the model building codes defines an unsafe building as one which is a) structurally unsafe, b) has inadequate egress, c) presents a fire hazard, or d) is otherwise dangerous to human life. Our concern this morning is with fire hazard. Therefore, let's review our understanding of what we mean by this. The threat or hazard of fire to human life evolves over time through a sequence of events. I've listed on slide 2 a series of stages in the development of a fire and shown graphically at the bottom of this figure on the horizontal axis time and vertically some measure of fire intensity. The graph represents the process of evolution of a fire and the occurrence of various phases. It all begins, of course, with a pre-existing unsafe condition or practice, followed by the subsequent steps of fire growth and extinction. Alternatively, at some point an intervention strategy may be employed, e.g., extinguishment in which case, hopefully, the fire is knocked down before its intensity exceeds acceptable limits.

My point in going through this, perhaps simple-minded illustration, is simply this, our business is to provide the technical basis for interventions that work in reducing fire loss. It's our conviction that an orchestrated *set* of intervention strategies is essential. I've argued that it is socially unacceptable to create an environment in which no unsafe condition or practice exists. It would be nice, but it's unrealistic. By the same token it's unreasonable to expect that one single fire protection system or strategy is sufficient to deal with all possible fire threats and that it makes no difference what we put into a facility or what materials we use in its construction, furnishings, or finishings.

Now, let's take a closer look at what constitutes the threat of fire to human life. Slide 3. First of all we have the fire itself, the heat and flames, and the direct effect of them on building occupants. Secondly, we have the combustion products, generally smoke, and thirdly we have the overall event of the fire. Now we could think of each of these in terms of the threat that they pose to individuals who might be in the

room of origin of the fire or elsewhere in the building in which fire might occur. We can think specifically what senses, physiologically are insulted by that aspect of the fire threat and develop means to characterize when and at what point and to what extent those senses are threatened. It is important for us to understand clearly the limits of tenability for each of those threats. Some of the main ones include: the effect of heat on our sense of feel; the irritant, toxic and visual effects of smoke; and the psychological/physiological effects of the overall fire event in terms of stress on human occupants.

Also, we can consider the properties of materials or products involved in fire that give rise to these particular threats. For example, the pertinent parameters relating to heat and flames are fairly well understood. We have widely used test methods for flammability, ignitability, and combustibility, and we are working on measures of flame spread, and rate of heat release. These are measures we can use to understand the contribution of materials or products to the threat of fire to human life, and they can be used in the process of developing appropriate and effective intervention strategies. In the same way, we would like to understand the irritant threat of smoke. We know very little about that and are not all sure how to measure it. Those who have been repeatedly in direct contact with fire argue convincingly about its significance and importance in disorienting or otherwise threatening occupants in terms of their ability to escape.

The focus of our attention this morning of course is on inhalation toxicity. Not only are the lethal aspects of smoke important, but also the intoxicating or incapacitating effects of smoke which result in occupants being subjected to further assault from other fire threats. Similarly, the effect of smoke on visual obscuration interferes with occupants' ability to escape. We have reasonable measures of optical density, and of smoke generation properties of materials, and these are now widely used and cited in codes. Finally, we have no measures of material or product properties that have been related to the overall psychological stress of a fire, yet we know it's important.

Ideally, of course, we would like to have means to measure the fire properties of materials or systems that give rise to all of these threats. We would like to be able to predict the evolution of fire hazards in time and space, and use that understanding to test the effectiveness of various interventions.

Consider how, ideally, we might do this. I think we are all familiar with the personal computer, video games, and interactive graphics. So, let your imagination wander for just a moment and think about this problem in that context (slide 4). Ideally, we would like to be able to provide as input to the computer the design, contents, occupancy and use of a building including the major materials, furnishings and finishings, and the specific activity patterns and so on that are likely to take place in it. Secondly, we would like to be able to simulate a series of likely fire scenarios including ignition, what materials are involved and in what sequence, the responses of occupants and fire protection systems, etc., to the developing hazard. Thirdly, we would like to have a means to evaluate quantitatively the probable consequences of that simulation in terms of risk of life loss and injury, in terms of property loss, and in terms of cost, etc. Think about it. That would really be nice. That would provide us means to analyze actual fire data and probable fire scenarios; to test designs, materials, and furnishings, against those likely threats; and to test the performance-effectiveness of various fire protection measures or systems in dealing with those threats. This capability is now within our reach.

In fact, this is the principal focus of the program of the Center for Fire Research. Dr. Fowell's presentation will deal in some depth with where we are now in terms of our ability to do just this. Before that, of course, we want to describe for you in detail the toxicity test method. In closing, let me just briefly recount in this broader context of fire hazard assessment that fire safe material selection and use (slide 5) is situation specific, it depends in a very significant way on the design of the material in question, its form, contents, structure, on other materials present and their properties, on fire protection systems and many other factors.


Now, I'd like to introduce Dr. Barbara Levin who heads our Fire Toxicology Group. Barbara spent the last four years at NBS working on development of this test method, prior to that time she did postdoctoral work at the National Institute of Health in biochemistry and microbiology. She will be followed by Dr. Andrew Fowell. Andy is Chief of the Fire Safety Technology Division of CFR. Andy is a mechanical engineer with a background in fluid mechanics and heat transfer research. He has 16 years of private sector research and product development experience.

FIRE SAFETY USUALLY INVOLVES TRADE-OFFS

- **Function:**
 - **Strength, durability, weight, convenience, appearance, etc.**
- **Safety: An unsafe building:**
 - **Structurally unsafe**
 - **Inadequate egress**
 - **Fire hazard**
 - **Otherwise dangerous to human life**
- **Costs:**
 - **To buy, fabricate, maintain, replace, etc.**

FIRE HAZARD: Phases in Evolution

- A. Unsafe condition or practice
- B. Ignition
- C. Growth
- D. Spread
- E. Extinguishment
- F. Recovery

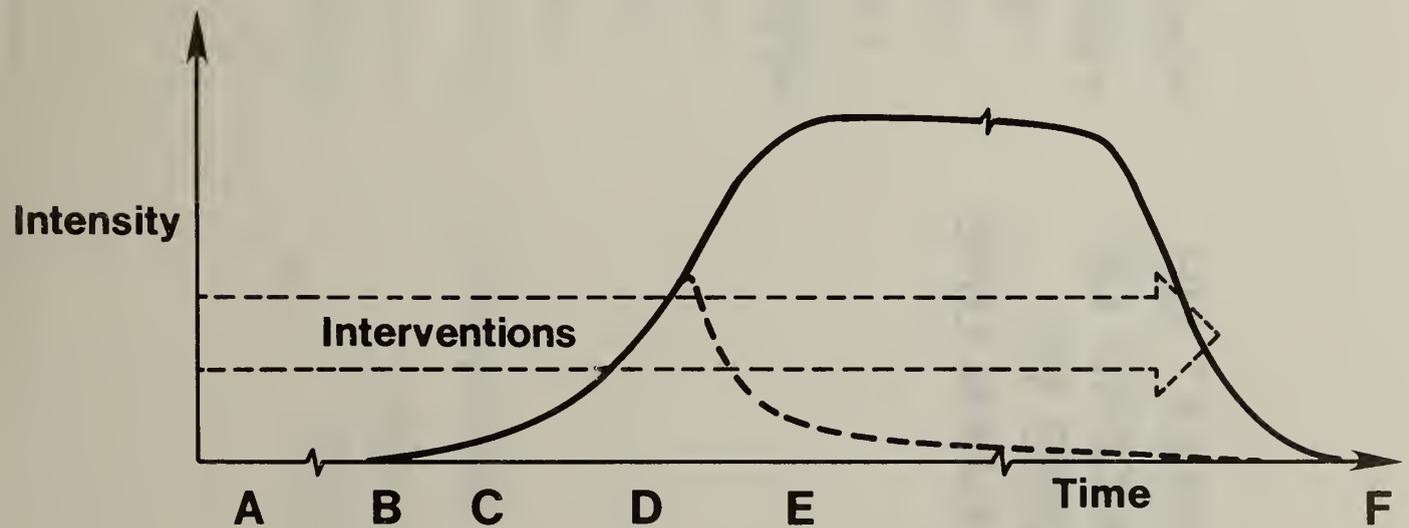

THREAT OR HAZARD OF FIRES TO HUMAN LIFE

- Heat and flames
- Smoke
 - Irritant
 - Inhalation toxicity
 - Visual obscuration
- Fire and smoke

HAZARD ANALYSIS

Ideal Approach

- **Specify design, contents, occupancy, use (including materials properties)**
- **Simulate likely scenarios**
 - **Ignitions (what, when, where)**
 - **Involvement (what, how much, where)**
 - **Responses (interventions)**
- **Evaluate probable consequences**
 - **Risk of life loss and injury**
 - **Property loss**
 - **Costs**
 - **Etc.**

“FIRE SAFE” MATERIAL SELECTION & USE

- **Design, occupancy, and use**
- **Materials and contents**
- **Systems**

NBS Protocol/Test Method for Assessment of the Acute
Inhalation Toxicity of Combustion Products
Barbara C. Levin

Today I plan to describe the toxicity test method that we have developed here at the National Bureau of Standards and to discuss its use and its limitations. Most of what I plan to discuss is in the NBS report entitled "Further Development of a Test Method for the Assessment of the Acute Inhalation Toxicity of Combustion Products" (NBSIR 82-2532) which you received at registration. I will certainly not be able to provide all the information that is in the report, but, hopefully, this presentation will introduce you to the report and will answer any of your current questions.

The first slide shows the objective and use of the NBS toxicity test method. The objective is to assess the acute inhalation toxicity of combustion products under specified laboratory conditions. Its intended use is for research and preliminary screening purposes by product researchers and material manufacturers.

In slide 2, I will present some definitions to familiarize everyone with the terminology used both in the report and this presentation. "Acute toxicity" is defined as the harmful effects of a single short exposure to combustion products generated by the thermal degradation of materials. "Toxic hazard", on the other hand, is defined as the material and environmental conditions which increase the probability that a toxic atmosphere will occur and an injury will result. I'd like to emphasize that the test method only addresses acute toxicity. It does not address the problem of total toxic hazard. In this test method we also discuss "mass loading" which is the amount of material placed in the furnace and thermally degraded during the test itself. Another term is "auto-ignition temperature". This is defined as the lowest furnace temperature which causes a material sample, which is introduced into the cup furnace, to spontaneously ignite within 30 minutes. For each material, the toxicity test is performed at two different temperatures, a flaming temperature-25°C above the auto-ignition temperature and a non-flaming temperature-25°C below the auto-ignition temperature.

Slide 3: Another term which needs definition is "concentration" which is used in the test report in two slightly different contexts. In one case, the concentration of a specific gas that is evolved into the exposure chamber can be measured with laboratory instruments in parts per million (ppm), for example, carbon monoxide. On the other hand, it is very difficult to measure the concentration in ppm of a mixture of unknown combustion products generated when a material sample is decomposed. Therefore, the concentration of mixed combustion products is defined as the mass loading of the material that is placed into the cup furnace divided by the exposure chamber volume. This concentration is expressed in milligrams per liter (mg/l). "Concentration-response" is a graphic representation of the concentrations (ppm or mg/l) required to produce a specified response in a percentage of animals. In this test method, the biological response or endpoint which is measured is animal death within the 30 minute exposure and/or within a 14 day post-exposure observation period. From such a concentration-response curve (an example will be shown later) an LC_{50} value can be estimated. An " LC_{50} " is defined as the concentration which is necessary to produce death in 50% of the test animals exposed for 30 minutes and observed for 14 days. The LC_{50} values presented in the toxicity test method report were statistically calculated by the method of Litchfield and Wilcoxon (J. Pharmacol. and Expt. Therapeut. 96:99-113, 1949).

Slide 4 shows a picture of the NBS exposure chamber. The test method involves three components: a combustion system, a chemical analytical system, and an animal exposure system. The combustion system is located below the left side of the exposure chamber and consists of a cup furnace (slide 5) in which the test material is decomposed at a preset temperature, 25°C above or below the predetermined auto-ignition temperature. The combustion products are generated directly in the exposure chamber. Some of the smoke is pumped from the exposure chamber and analyzed continuously for carbon monoxide, carbon dioxide, and oxygen during the 30 minute exposure. All smoke removed for chemical analysis is returned to the exposure chamber, i.e., the system is kept static.

This test is designed to assess the acute toxicity of combustion products. In order not to confound the results with the physiological effects of heat stress or oxygen deprivation on the animals, the test

method specifies that the average temperature at the nose level of the animals during the exposure should not exceed 40°C. Temperatures at the nose position of the animals as well as in the cup furnace are monitored continuously during the exposure. Also the test method specifies that the average oxygen levels throughout this exposure should not fall below 16%.

The exposure chamber is a 200 liter rectangular box and the animals, six rats per experiment, are exposed in a head-only mode, i.e., only the heads of the animals are exposed to the combustion products. The exposure lasts for 30 minutes after which the animals are kept for a 14 day post-exposure observation period. Blood is sampled from two of the six animals and analyzed for carboxyhemoglobin. Carboxyhemoglobin is the molecule that is formed within the blood when animals inhale carbon monoxide. As the carboxyhemoglobin levels increase, the oxygen that is usually bound to the hemoglobin is now displaced. In other words, when the blood becomes highly saturated with carbon monoxide, the carboxyhemoglobin levels increase, the oxyhemoglobin levels decrease, and the animals become starved for oxygen.

This test method also includes an optional 10 minute exposure to a mass loading of 30 milligrams per liter. The 10 minute exposure is intended primarily to allow product researchers and material manufacturers to distinguish those materials which rapidly produce lethal concentrations of toxicants. The response of the animal to the toxic insult absorbed during the test may occur during the 14 day post-exposure period.

Slide 5 is a picture of the cup furnace consisting of a removable quartz beaker surrounded by a heating element which is encased in insulation. A thermocouple is placed in a well within the quartz beaker to monitor the temperature throughout the exposure.

Most of the limitations of this test method concern the combustion system (slide 6). One of the limitations is the quartz beaker size which limits the quantity of material, especially low density materials, that can be accommodated by this combustion system. NBS did experiment with a larger size cup furnace which was an improvement, but it still does not permit large quantities to be tested. In addition, the cup furnace does not allow

for the continuous measurement of material mass loss throughout the experiments. In our present system we weigh the quartz beaker plus the material before and after the exposure to determine how much material was decomposed during the 30 minute exposure. Also, the effect of sample orientation is not addressed by this test method. A material is literally dropped into the cup furnace and falls whichever way it falls. Composite materials referred to as "assemblages of nonuniform structure" in the test method report have not been evaluated by this combustion system. And finally, there are two degradation modes, flaming and nonflaming; we do not look at all possible fire conditions.

As mentioned earlier, materials are examined above and below their auto-ignition temperature. It would make the test extremely costly if every material had to be tested at every temperature. The results of NBS and the laboratories that participated in the interlaboratory evaluation of the test method and data in the literature all show that the most toxic conditions are generated at temperatures close to each material's auto-ignition temperature. As the temperature rises and approaches the auto-ignition temperature, more and more of the material is degraded and more toxic products are produced. And, of course, in the flaming mode, the higher the temperature, the more complete the combustion, the ultimate result of which is the production of only carbon dioxide and water. If materials are examined under their most toxic conditions, then we avoid false negatives, i.e., the situation where a material may produce even more toxic products under conditions that have not been tested. The material modacrylic was decomposed at different temperatures in both the flaming and nonflaming mode. The results (slide 7) clearly show that as the temperature increases in the nonflaming mode, the LC_{50} decreases, i.e., less material is needed to cause the animals to die. The lower the LC_{50} value, the more toxic the situation is.

During the interlaboratory evaluation of the toxicity test method, seven laboratories examined a total of 12 materials including both synthetic and natural materials. Not all the laboratories looked at all 12 materials. The natural materials were Douglas fir, red oak and wool; the others were all synthetic. The material abbreviations shown (in slide 8) are used throughout

the toxicity test method report. The test results that are provided here and in the report pertain to the particular samples of these materials that were used for this study and are not necessarily representative of the generic class of materials that would fall under this particular name.

Slide 9 shows a typical concentration-response curve from which the LC_{50} or the EC_{50} (the concentration necessary to incapacitate 50% of the animals) can be estimated. The Y axis gives the percent response of the animals and the X axis provides the concentration of the combustion products as defined by the mass loading of material per unit chamber volume. Each point (on this graph) is a single test consisting of six animals which were exposed to one mass loading. From such data, we can now statistically calculate the LC_{50} or the EC_{50} . During the development of the test method, different biological endpoints were examined. The LC_{50} was calculated for the 30 minute exposure itself as well as for the 30 minute exposure plus 14 day post-exposure observation period. In addition, the EC_{50} for 30 minutes and the times-to-incapacitation were also determined.

Slide 10 shows NBS results for flaming combustion. The EC_{50} , the concentration that caused 50% of the animals to become incapacitated in the 30 minute exposure; the LC_{50} , the concentration that caused death in 50% of the rats in the 30 minutes and 14 days; and the LC_{50} , the concentration that caused lethality in 50% of the rats during the 30 minute exposure itself, are plotted against the mass loading divided by chamber volume for all 12 materials. In classical toxicology, one material is considered significantly more toxic than another material if the toxic concentrations differ by an order of magnitude. However, in this series of experiments, only one material (PTFE) turned out to be orders of magnitude more toxic than the other materials tested.* These data also show that regardless of the endpoint (EC_{50} or LC_{50}) examined, the relative toxicities of the materials do not significantly change except for PTFE. With this particular material, all deaths occurred post-exposure. No incapacitation or death was observed during the thirty minute exposure. A hundred fold increase in the mass loading of this material still

* Experiments carried out in another laboratory subsequent to the publication of this report indicate that the conditions of thermal decomposition used in the NBS test--i.e., the absence of flame from other combustibles--may not be appropriate to the toxicity testing of PTFE (the only polymeric material which does not contain hydrogen). Testing in a hydrocarbon flame indicated the LC_{50} to be slightly less than but of the same order of magnitude as for the other materials tested.

did not produce any incapacitation or death within the 30 minute exposure. Our conclusion from this information is that the biological endpoint that provides the most information as to the toxicity of a material is the LC₅₀ for 30 minutes and 14 days which includes the post-exposure results.

The toxicity test method also includes an optional 10 minute test which is primarily designed to enable product researchers and material manufacturers to distinguish those materials that rapidly produce effective concentrations of toxicants. Slide 11 shows the results of this test performed on two materials - PVC and PVC-ZnFeCN under both flaming and non-flaming conditions. These materials have the same chemical formulation except that the PVC-ZnFeCN has in addition zinc ferrocyanide, a smoke suppressant. The 10 minute results can be compared to the LC₅₀ values for 30 minutes and 14 days. Using orders of magnitude as the criterion to determine whether one material is significantly more toxic than another material, these two materials can not be distinguished by the LC₅₀ results. However, when the animals were briefly exposed for 10 minutes to 30 mg/l and observed for 14 days, the PVC-ZnFeCN killed 100% of the animals in all cases in both the flaming mode and the nonflaming mode. PVC, however, produced only one animal death in three experiments in the flaming mode and no deaths in the non-flaming mode. Therefore, the 10 minute test provides a means of distinguishing between materials which rapidly produce toxicants and those that do not.

As an example of the importance of following the toxicity test method closely, slide 12 shows some of the research performed at NBS to determine the best time to take blood samples. The test method specifies that the blood samples for carboxyhemoglobin measurements should be taken either at the end of the exposure or within 5 minutes following the end of the exposure. Slide 12 shows the percent of hemoglobin saturated either with oxygen or carbon monoxide plotted against time. The time axis is divided into the time of the exposure (30 min.) and a long post-exposure period during which blood samples were taken. These animals were exposed to an average concentration of 4100 ppm of carbon monoxide for 30 minutes and no animals died. During the exposure, there is a rapid increase in carboxyhemoglobin to a level of 84% and simultaneously, there is a rapid decrease in the oxyhemoglobin. Immediately upon removal of these animals from the chamber, the carboxyhemoglobin levels start to drop. The decrease in percent carboxyhemoglobin is so rapid that if blood samples are taken long after the exposure is over, the levels observed will not be related to that which the animals actually experienced during the

exposure itself. Therefore, we do recommend arterial cannulation of the animals. This procedure allows blood sampling without removing the animals from the exposure conditions. However, if cannulations are not performed, then rapid sampling is important for reliable results. The longer the delay, the more significant the error.

Post-exposure death was not an isolated phenomenon. The combustion products of many materials produced both within-exposure deaths and post-exposure deaths at the concentrations tested. A few materials produced only within-exposure death and a few materials produced only post-exposure death. Therefore, in the assessment of the toxicity of the combustion products of materials, it is important to examine both within-exposure and post-exposure deaths. The test method specifies that the animals be observed for 14 days, a time period during which the various materials caused deaths (slide 14).

What about the reproducibility of this test method? As mentioned earlier, an interlaboratory evaluation was conducted. The LC_{50} results for 30 minutes and 14 days for Douglas fir as determined by seven laboratories are shown in slide 15. NBS is listed here at NBSa and NBSb because NBS tested both a 360 ml furnace and 950 ml furnace. Douglas fir is the appropriate material to examine for reproducibility across laboratories as all of the laboratories tested Douglas fir and only a few laboratories tested each of the other materials. The Douglas fir results show good reproducibility between laboratories under both non-flaming and flaming conditions. It is important to note that this was an interlaboratory evaluation; it was not a round-robin in which each laboratory was told exactly what concentrations to test and how to exactly replicate experimental conditions. There were variations both in how experiments were run and the methodology used. However, slide 15 still shows good reproducibility between laboratories. Data for other materials can be found in Table 17 of the test method report (NBSIR 82-2532). NBS is planning to publish a report on the interlaboratory evaluation of this other data soon.

In conclusion, this presentation has described very briefly the toxicity test method that was developed here at the National Bureau of Standards and discussed its use and its limitations. The Center for Fire Research is planning future work to correct these limitations and Dr. Fowell will be discussing our future research plan after the coffee break. Thank you.

NBS TOXICITY TEST METHOD


- **Objective:**
To assess the acute inhalation toxicity of combustion products
- **Use:**
Research and preliminary screening purposes by product researchers and material manufacturers


DEFINITIONS

- **Acute toxicity:** Harmful effects of a single short exposure to combustion products generated by the thermal degradation of materials
- **Toxic hazard:** Material and environmental conditions which increase the probability that a toxic atmosphere will occur and an injury will result
- **Mass loading:** Amount of material loaded in furnace in grams
- **Auto-ignition temperature:** The lowest furnace temperature at which a material sample introduced into the test furnace will spontaneously ignite within 30 minutes

DEFINITIONS (cont'd)

- **Concentration:** Mass loading per unit of exposure chamber volume expressed in mg/l
- **Concentration-response:** Concentration plotted against the percentage of animals that die during the 30 minute exposure and 14 day post-exposure period
- **LC50:** Concentration that is determined statistically to produce death in 50% of the test (animal) population exposed for 30 minutes and observed for a period of 14 days

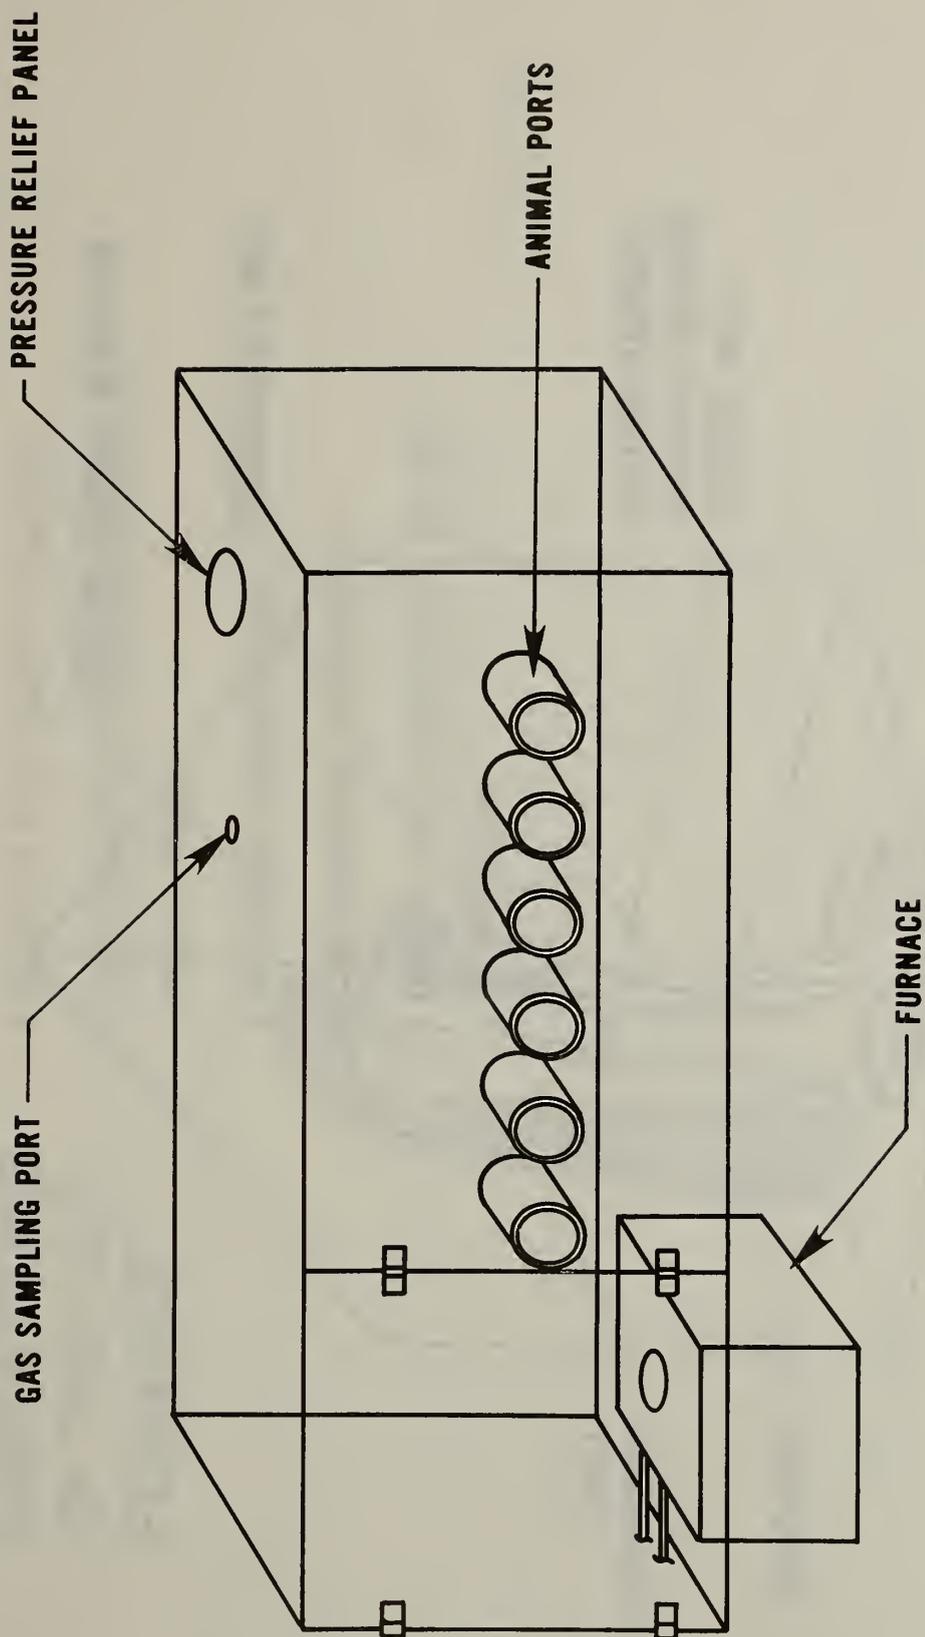

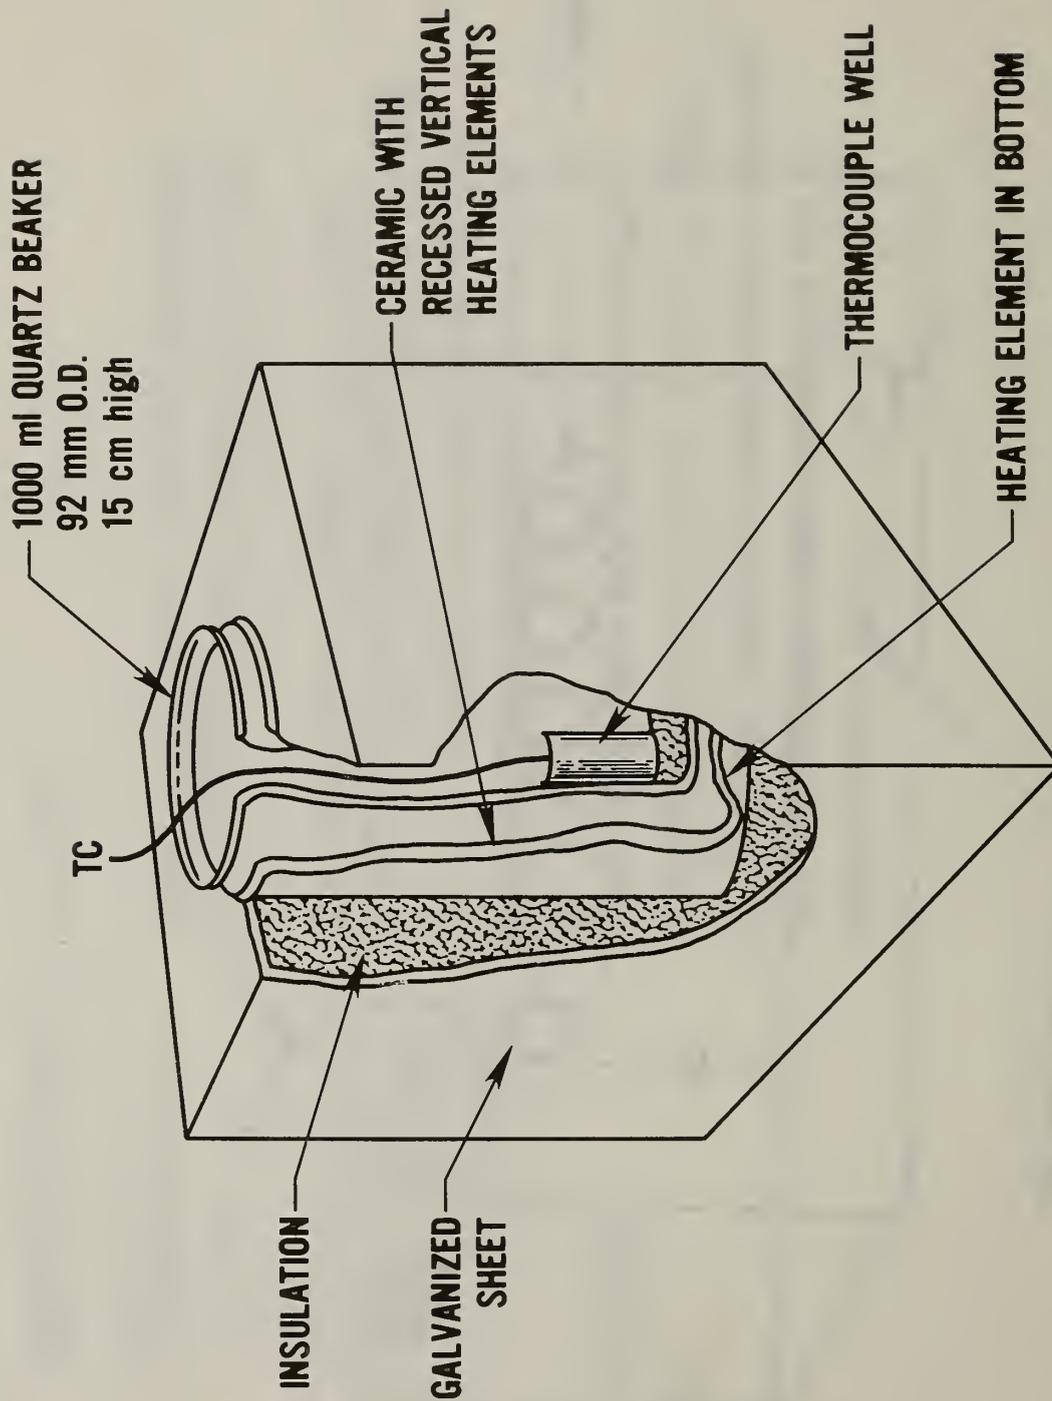

LIMITATIONS OF THE CUP FURNACE

- **Size of the quartz beaker**
- **Continuous measurement of mass loss**
- **Sample orientation**
- **Composite materials**
- **Does not represent all fire conditions**

TOXICITY OF MODACRYLIC AT DIFFERENT TEMPERATURES


<u>Mode</u>	<u>Temperature</u>	
	(°C)	LC50, 30 min. + 14 days*
Flaming	760-775	7.1 (6.4-7.9)**
Non-flaming	710-720	7.8 (6.3-9.7)
	445-460	10.0 (6.9-14.4)
	390-400	13.6 (10.7-17.3)
	295-305	21.8 (18.4-25.8)
	250-260	~23.8
	200	> 22.6


*Laboratory 4 data

**95% confidence limits

INTERLABORATORY EVALUATION

<u>MATERIALS</u>	<u>ABBREVIATION</u>
• Acrylonitrile-Butadiene-Styrene	ABS
• Douglas Fir	DFIR
• Modacrylic	MOD
• Polyphenylsulfone	PPS
• Polystyrene (GM 51)	PSTY
• Polytetrafluoroethylene	PTFE
• Poly(Vinyl chloride)	PVC
• PVC with zinc ferrocyanide	PVCZ
• Polyurethane (flexible) (GM 21)	FPU
• Polyurethane (rigid)	RPU
• Red Oak	REDO
• Wool	WOOL

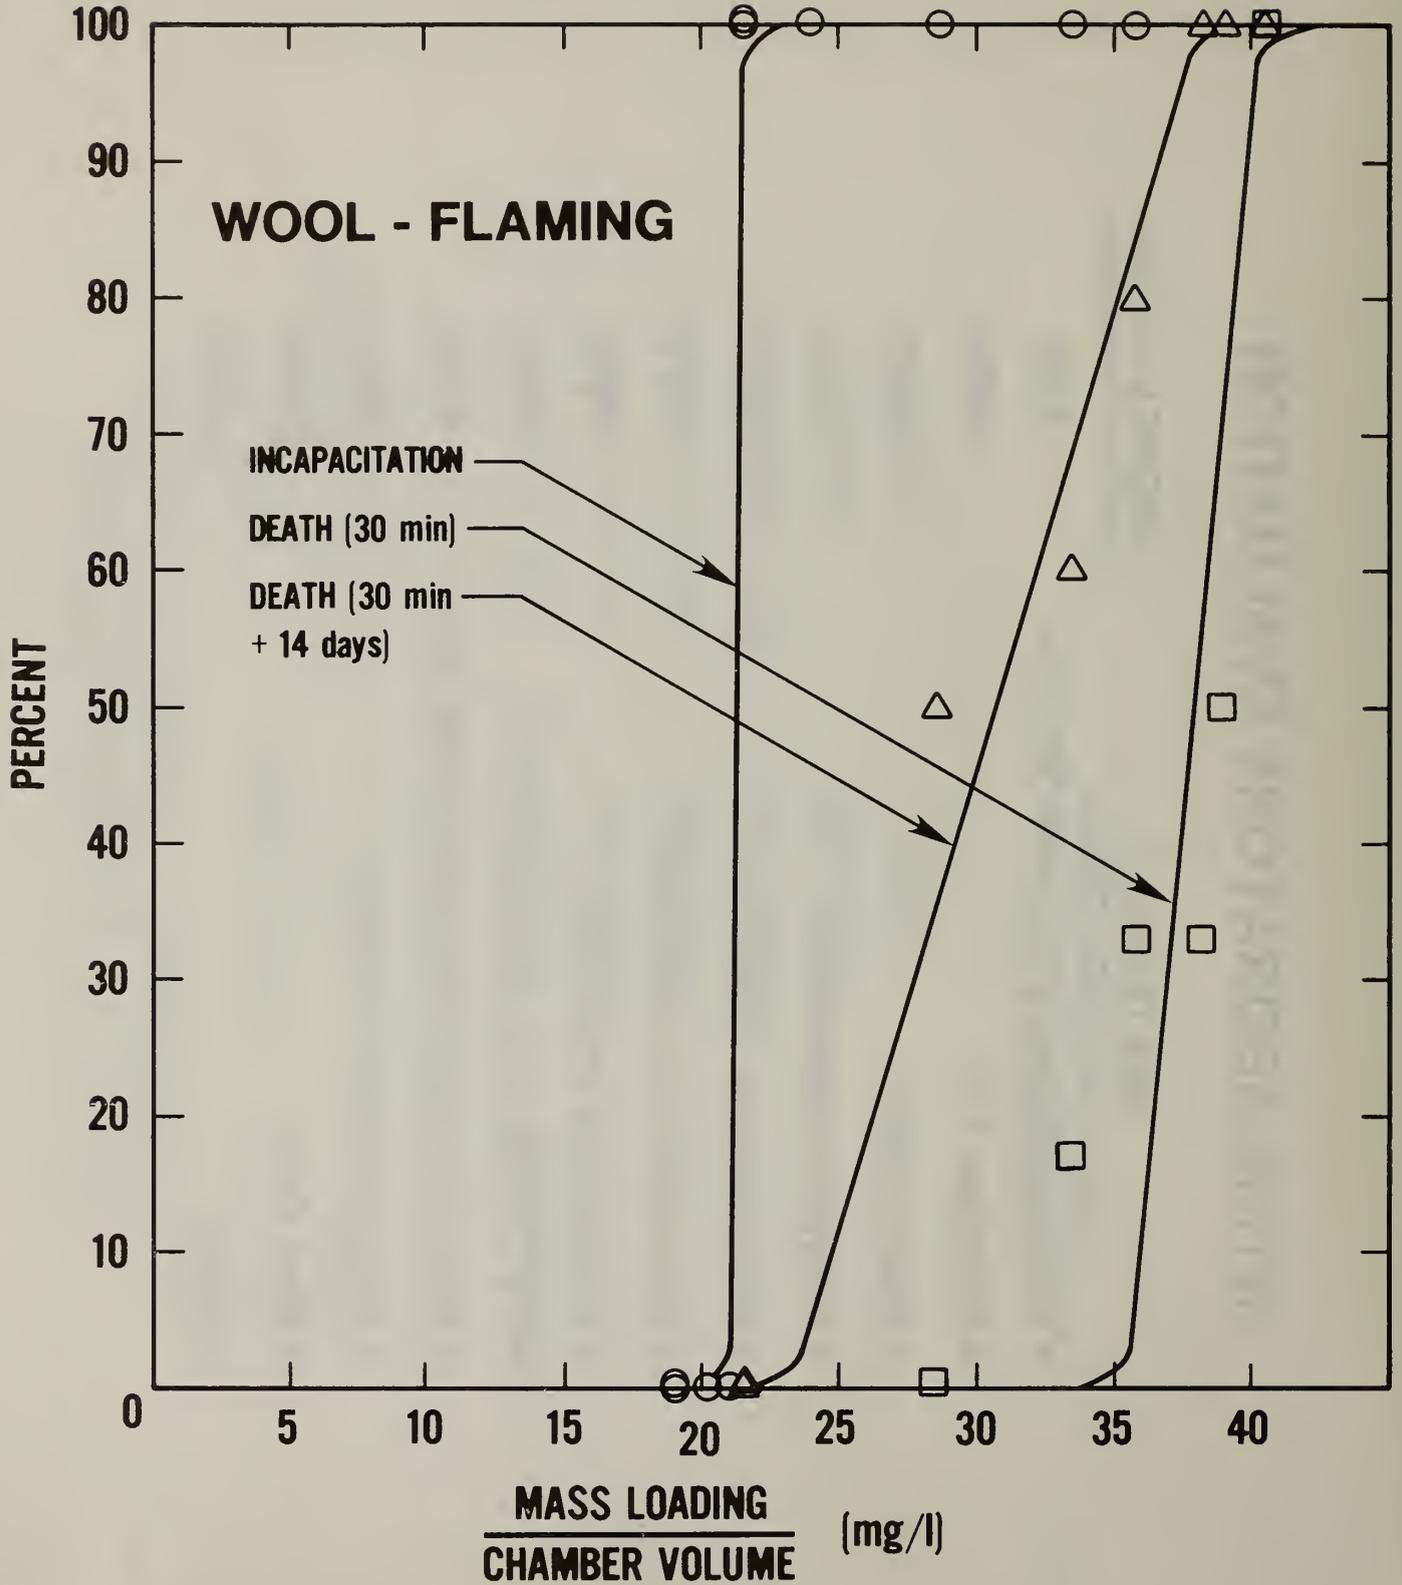

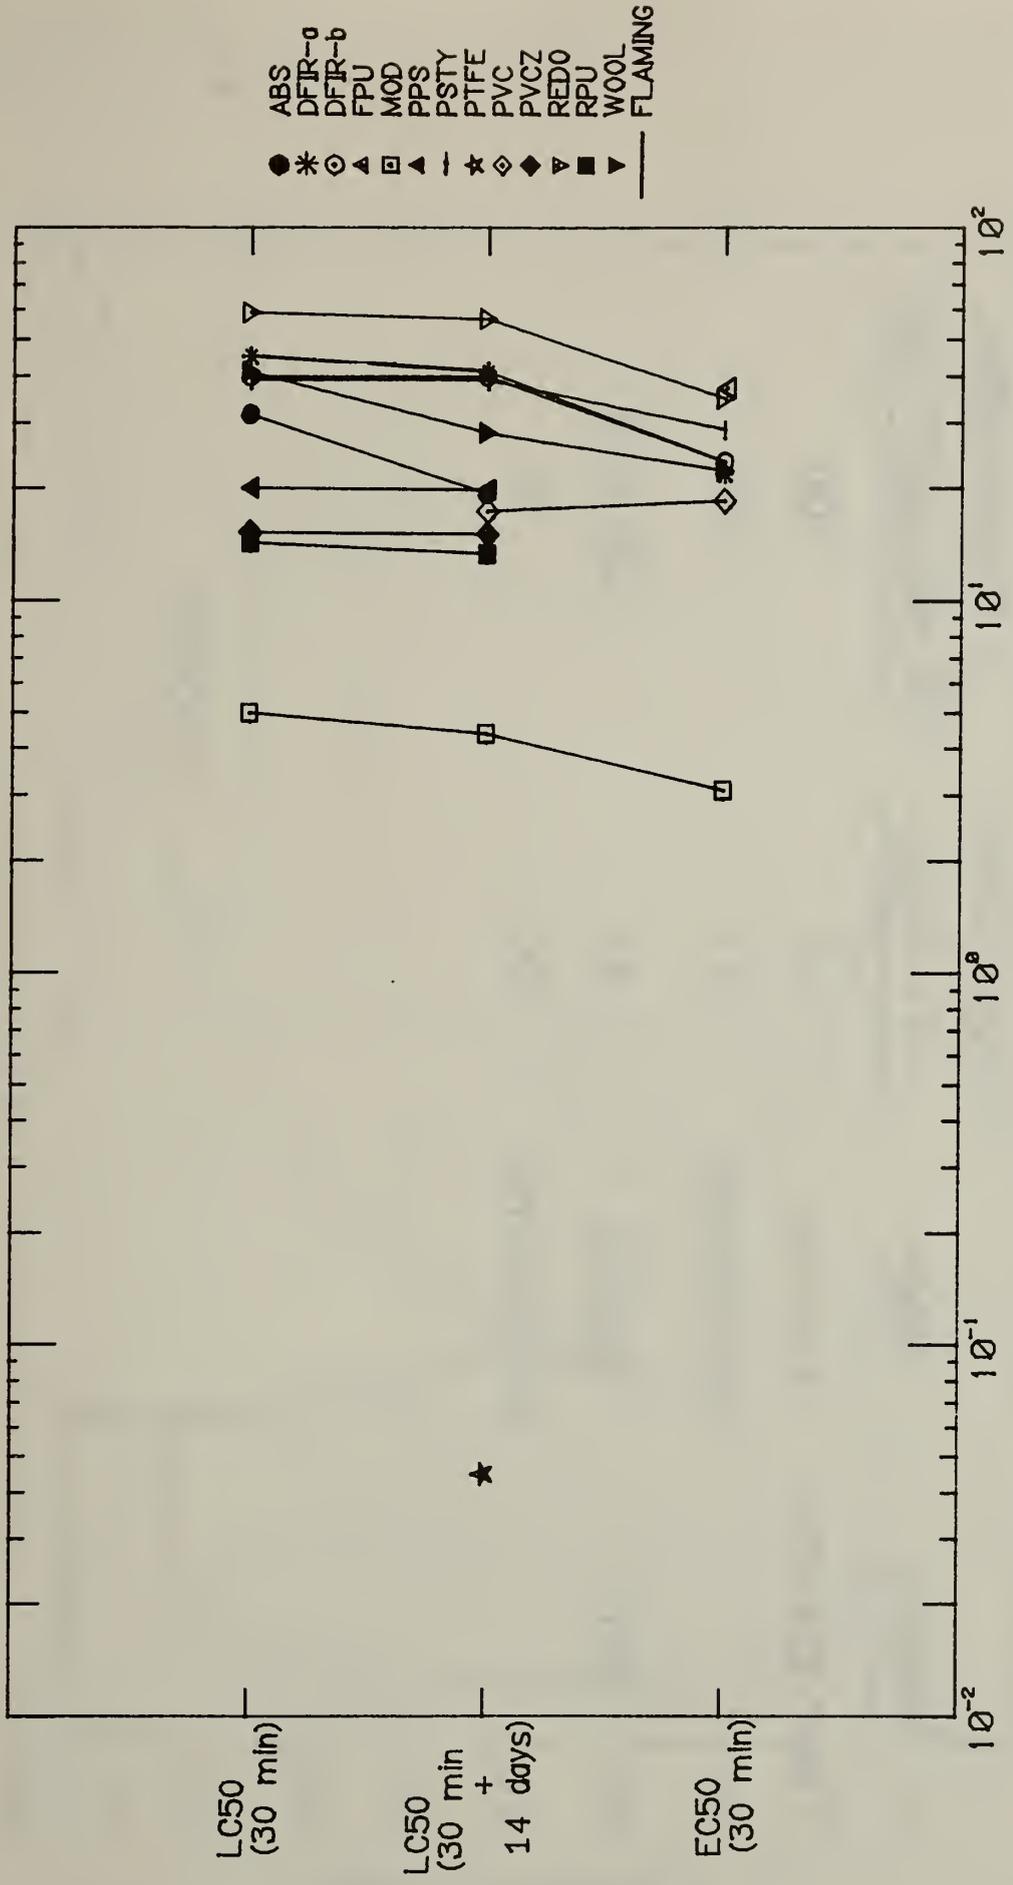


MASS LOADING/CHAMBER VOLUME (mg/l)

COMPARISON OF LC50 AND 10 MINUTE TEST RESULTS

<u>Material</u>	<u>Mode</u>	LC50 (30 min.	% Deaths After
		+ 14 days)	10 min. at 30 mg/l
PVC-ZnFeCN	flaming	15	100
	non-flaming	11	100
PVC	flaming	17	20, 0, 0
	non-flaming	20	0

CHANGE IN CARBOXYHEMOGLOBIN AND OXYHEMOGLOBIN¹.

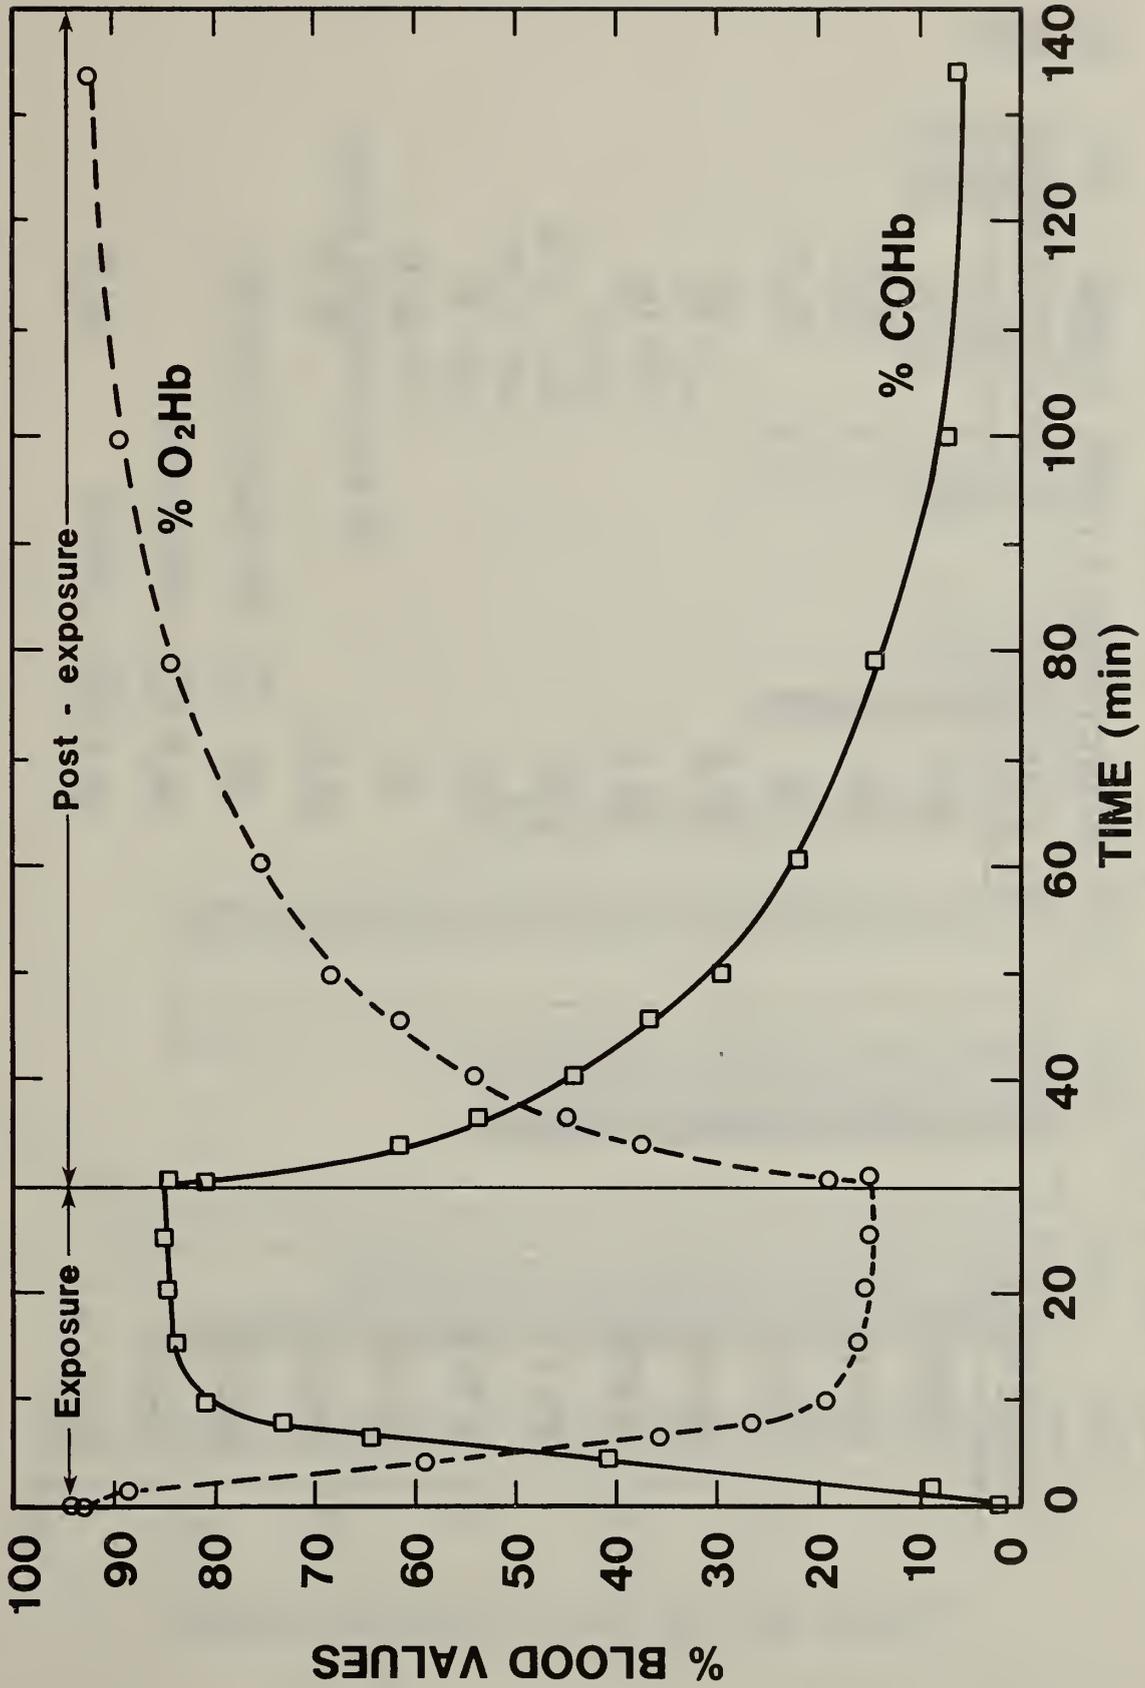


1. Animals exposed to an average concentration of 4100 ppm of Carbon monoxide over 30 minutes

EXPOSURE AND POST-EXPOSURE DEATHS

<u>MATERIAL</u>	<u>DEGRADATION MODE</u>	
	<u>FLAMING</u>	<u>NON-FLAMING</u>
ABS	W,P	P
DFIR	W	W,P
FPU	W	W,P
MOD	W,P	W
PPS	W,P	W
PSTY	W	-
PTFE	P	P
PVC	P	W,P
PVCZ	W,P	W,P
REDO	W	P
RPU	W,P	-
WOOL	W,P	W,P

W - Within exposure P - Post-exposure

TIME OF POST-EXPOSURE DEATHS

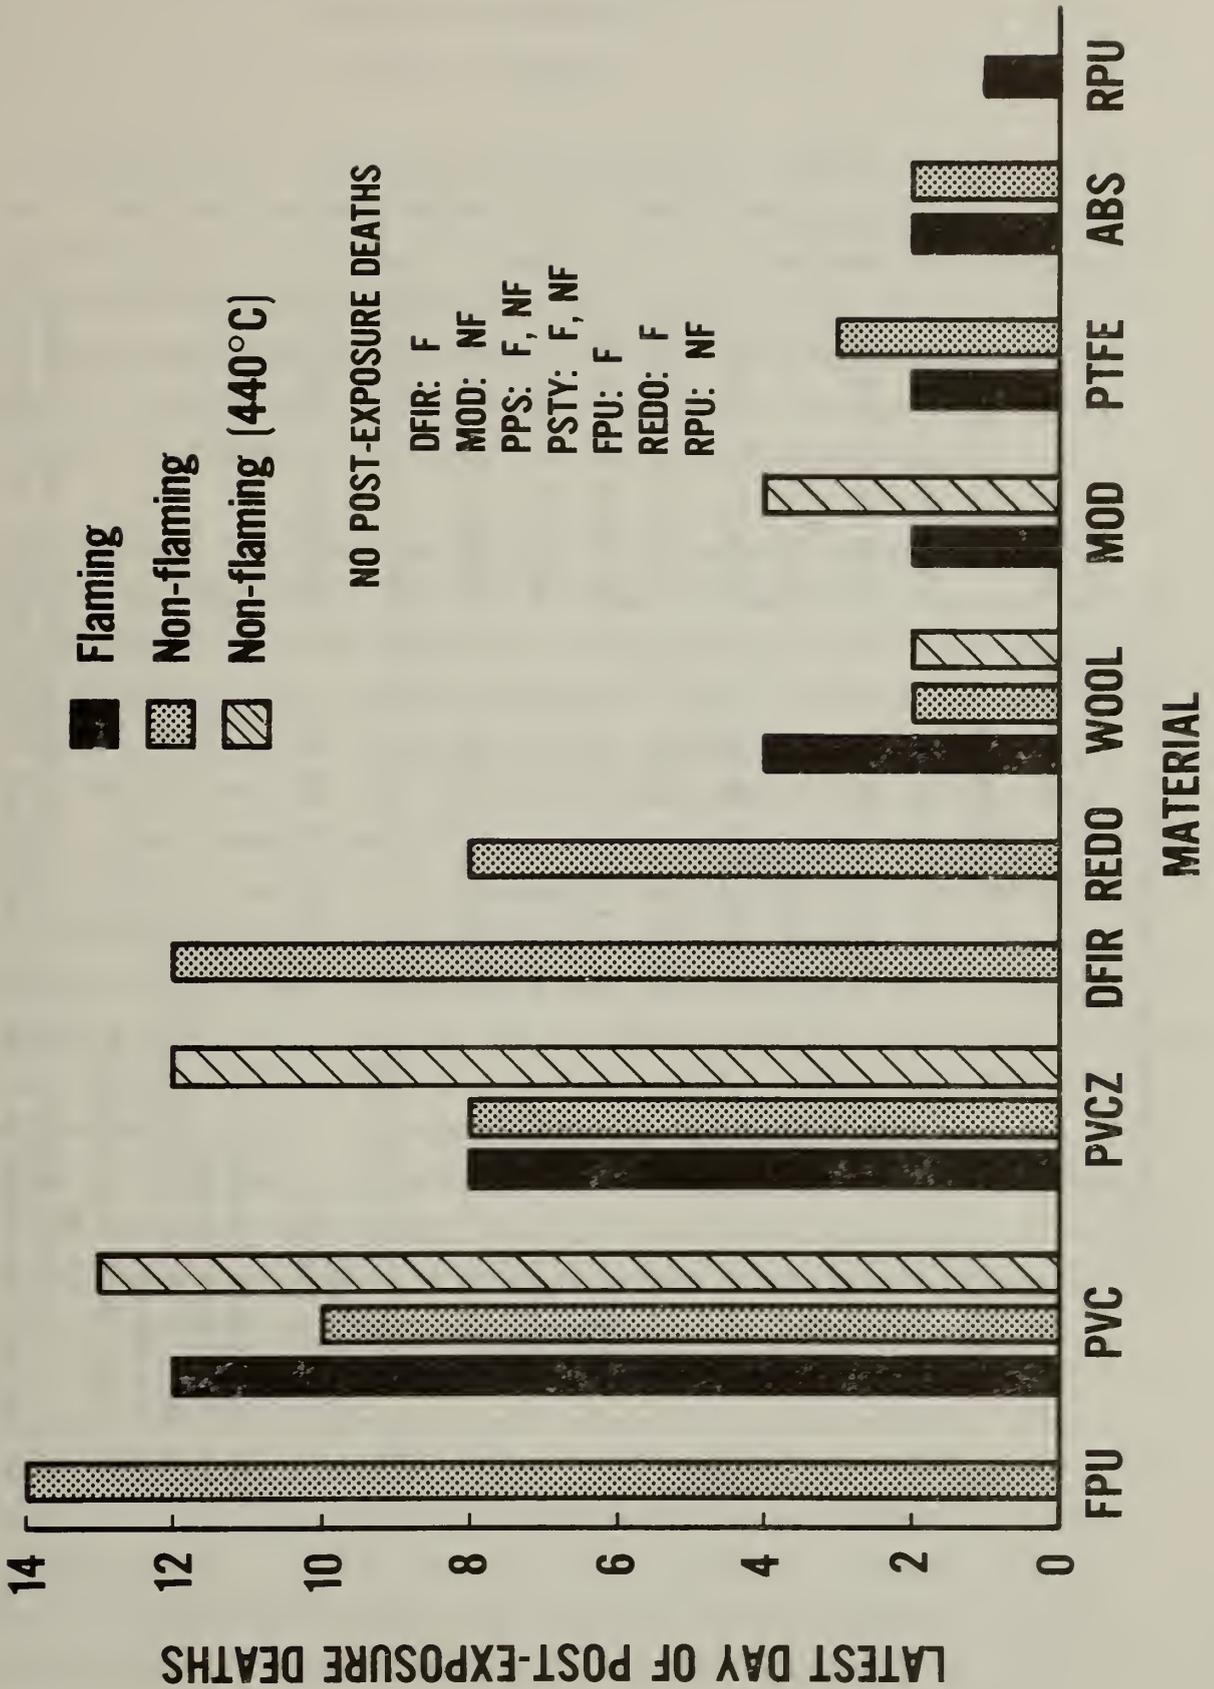

Interlaboratory Evaluation of Douglas Fir

LC₅₀ (30 minutes + 14 days)

<u>Laboratory</u>	<u>Non-flaming</u>	<u>Flaming</u>
1	16.7(14.5 - 19.3) ^c	35.8(28.6 - 44.9)
2	27.6(22.9 - 33.3)	45.3(39.0 - 52.7)
3	26.8(21.3 - 33.7)	28.0 ^d
4	24.0(19.9 - 29.0)	29.6(22.7 - 38.6)
5	25.9(20.0 - 33.5)	38.4(35.2 - 41.9)
NBS ^a	20.4(16.4 - 25.3)	41.0(33.0 - 50.9)
NBS ^b	22.8(20.2 - 25.8)	39.8(38.2 - 41.4)
8	18.5(17.3 - 19.8)	29.8(23.9 - 37.1)

Mean \pm 95%
confidence limits^e

22.8(13.4 - 32.2)

36.0(21.1 - 50.8)

a: NBS small furnace

b: NBS large furnace

c: mg/l (95% confidence limits)

d: estimated

e: eight data sets included

In this table the numbers quoted are as calculated from the data provided by various laboratories. The 95% confidence limits reflect only statistical variations.

Hazard Assessment--Review of Research in
Progress and Planned
Andrew J. Fowell

My purpose today is to describe the additional research planned at NBS relating to the toxicity test method and to toxic hazard assessment. First, I'll discuss some of the current limitations of the test method particularly those on which we intend to concentrate our effort. Then, I'll describe various approaches to hazard assessment, and give an example of the kind of output that we expect from some of the more elaborate techniques. Finally, I'll outline our plans for work in hazard assessment methodology.

(See slide 1). Several test methods for measuring combustion product toxicity are now available. They can provide information for research and product development but they should not be incorporated directly into building codes and standards, for a number of reasons. There is very little available information on toxicity of materials obtained using either the NBS or the other test methods and the ways to use this information have not yet been developed. Also, some technical issues need to be resolved including how to deal with composite assemblies of materials and material orientation. At NBS we are focusing on two areas: the further refinement of the test method to address some of the current limitations; and the development of a framework for combining toxicity information with the other information so that regulators or decision makers can make better decisions on fire safety. This other information--which includes the material's own fire properties, use data, and statistics on fires--may be considered "application information". The combination of "material performance" data with "application information" comprise toxic hazard assessment. This is shown in dashed lines because to date we lack procedures for conducting such an assessment.

What are the current limitations of the toxicity test method? (See slide 2). Barbara Levin mentioned these. The time to reach untenable conditions is a key factor in addressing hazard. So, an indication of the rates of generation of combustion products is important. Therefore, some continuous measure of mass loss of the material would be a good indicator. Few materials are ever used on their own; they are usually used in

combination with other materials or formed into assemblages of materials. The current test method has not really addressed composite materials. To test these materials a different combustion system will probably be needed, and it is likely to be some form of radiant system. The size of the present cup furnace is a limiting factor for low density materials. In burning materials, oxygen is a critical factor in determining the products of combustion, particularly carbon monoxide. Therefore, some measure or control of the oxygen in the combustion system should be included. The exposure conditions, the ventilation conditions and the material orientation all are factors that contribute the combustion products and therefore our combustion systems must take this into account.

We in the U.S. are not the only people working on combustion toxicity. Efforts are underway in Japan, Germany, Canada, England, France, Sweden, and many other countries. The Japanese are focusing on the correlation between small scale and large scale tests, which bears on the subject of verification. The Japanese also are attempting to simulate real fire conditions. The Canadians concentrate more on analytical techniques rather than exposing animals. Although the English researchers have used primates in their tests, they concentrate mostly in the analytical area. We in the U.S. have set up collaborations with both Japan and Canada to exchange information and look at the correlation between our various test methods and the results of using the various techniques.

What are we planning to do about the limitations of the test method mentioned? (See slide 3). The first effort will be to better control combustion by redesigning combustion systems. We have done some initial work on radiant heating systems. Our work in full-scale testing and modeling of fires will give us a lead on the design requirements of that combustion system. At the same time as refining the combustion system, we may modify the animal exposure system if necessary to control the temperature at the noses of the animals, and the oxygen level to make sure that the animals aren't too affected by high gas temperatures or oxygen depletion.

Once modifications have been made to the test equipment we will correlate any new measurements with the data we have from the old system.

Following the modifications to the equipment, we plan to examine the composite material and material orientation questions. Another problem we see with toxicity testing is cost. It would be very nice to explore every parameter in every direction. This is impractical. Some time can well be spent selecting appropriate standard test conditions.

As we have said a number of times today, when considering the suitability of a material for a particular use the results of small scale toxicity tests should be considered along with information on its other fire properties. In fact, in the test method itself we list a number of these properties in the "Significance and Use" section of the report, (section 2.2.2).

Combining this fire property information with application information leads to hazard assessment. Various approaches that either have or can be used for hazard assessment are listed on slide 4. I'm going to concentrate on the last two items. They are the more quantitative approaches. But first, let's look at chemical analysis techniques. Since they don't rely on animal testing, some unsuspected or unknown toxicants can be missed. The French code requires* the use of a chemical analysis technique in the regulation of building materials in public buildings. They consider two gases, hydrogen chloride and hydrogen cyanide. A limit is placed on the maximum concentration of these gases that could possibly be generated by the chlorine and nitrogen in the furnishings of the room and the wall covering materials. There are various weighting factors incorporated into the calculations when floors and walls are considered. The second approach on the list, subjective assessment, is really the approach that is being used today. It's a way of comparing the various fire properties of different materials with those of some standard material or with some other familiar material.

Of the the two more quantitative approaches to hazard assessment the last one, mathematical modeling, is the more sophisticated or elaborate. It combines mathematical models of fire growth and fire spread with the capabilities of computers to predict the time to reach untenable conditions

*Since this presentation, it has come to our attention that this analysis technique is not in regular use in France.

within various parts of the building under various fire scenarios. But first, let's look at each of the two quantitative approaches.

The information that we get from the test method, the LC_{50} , is the mass loaded in the combustion system divided by the volume of the chamber which is necessary to cause death in fifty percent of the animals as a result of a 30 minute exposure (slide 5).

If we multiply the LC_{50} by 30 minutes, it gives us some idea of the lethal dose D^* for the animals. Now consider a compartment containing a burning material. The rate of mass loss of that material is \dot{m}_f . The burning material generates flow into and out of the room through any open doorway or window. The volume flow out of the room \dot{v}_o can be calculated from the heat generated by the burning material and the temperature in the room. So we have a concentration of toxicants flowing out of the room, the mass generated divided by the volume flow rate. Multiply that by the time under consideration and we have a dose. So now we have a very crude, very simple way, assuming the material is burning at a steady state, to calculate the time to reach a lethal dose. Now I'd be the first to recognize that for many toxicants the lethal dose itself is dependent on concentration. In fact, in the test method, we recognize this by doing a 10 minute test. But, for the purposes of this crude calculation we'll make that assumption. We can elaborate on this technique by adding to the calculation the time for a material to get involved in the fire. The techniques to do this are available and they give us a much better indication of time to reach toxic conditions.

A more elaborate or ideal method of assessing fire hazard is to combine the latest models of both fire growth and fire spread with the capabilities of computers to predict the changing conditions in various parts of a building. (See slide 6). Here I show just two examples of fire growth models. One developed at Harvard for single compartments and another one developed by Professor Tanaka in Japan, for multi-room or multi-compartment spread of smoke throughout a building. There are many models and many submodels available. In the first one, the fire growth within a single compartment, the usual approach is a zone model where the compartment is divided into a number of zones, such as the upper smoke layer, the lower cooler layer, and the turbulent plume above the fire. (See slide 7). Some of the factors that are considered in developing these various models include the air flow

into the room, the mixing of the products of combustion into that inflow air, the escape of the products of combustion, heat transfer to the ceiling and walls, and radiation from the flame and from the upper zone to the floor and to other materials in the room. This particular model is undergoing various stages of modification and parameters are constantly being added or modified. Thus, the model is becoming much more sophisticated.

This next slide (see slide 8) is a pictorial representation of the Tanaka model of smoke filling a building. Starting in the upper left corner of the slide, we see a fire on the second level generating smoke which spreads from the room of origin into neighboring compartments and to the upper floors. As we examine the figures down the left hand side and then down the right hand side of the slide we see a progressive filling of the building with smoke. So, through a combination of models like these that we can generate the overall fire hazard or the fire safety picture for a particular building.

In the report on the test method, we list a number of factors that should be combined in assessing overall fire hazard. Some of these are listed on slide 9. These same factors really form the input to these mathematical models. It isn't a complete list but it does show you some of the pieces of information that need to be incorporated into the models to give us a good understanding of the fire growth. The output that is of interest to us at the present time is the time to reach tenability limits. These tenability limits have to do with toxicity, temperature, and visibility. We are examining the literature to determine what values to use for these limits.

An important purpose of modeling is to gain a better understanding of the fire growth process and to reduce the number of repetitive large scale tests that must be done. As a result many subroutines are continually being added to the modeling framework to account for the various components of the fire process. (See slide 10). Modeling capabilities are limited at this time, primarily by lack of data on both individual materials and composite materials. Another limitation is lack of information on the combustion products in under-ventilated conditions that are different from those of the test methods. This is one of the criticisms that a standard test method usually encounters. One of the problems with the models that are available today is they're not necessarily compatible with each other and so we will be working to improve

model compatibility. As I said, mathematical modeling is continually being improved by the incorporation of other factors. Factors currently being addressed are forced ventilation and wall fires. In most of the models that exist today, the flows within and between the various compartments associated with the fire, are assessed on the basis of the buoyant effects of the fire itself, whereas, in big buildings the heating, air conditioning, and smoke control systems are a major factor. Not only do we need combined models, or models that are compatible with each other, we also need efficient algorithms so that we can process each model conveniently. Another problem that we have encountered is that many of today's models can only be handled by the experts who developed them. So, effort needs to be directed at simplifying and refining the models.

Modeling gives a good overall picture of the fire growth process if you know where the fire starts, but what is the probability that a fire will start in a particular way, or particular location? We need more input on fire scenario probabilities. Fire statistics that are available today can provide some of this information.


These limitations notwithstanding current fire and smoke models can provide useful information. For example, we have run two of the models, the two that I mentioned earlier, the Harvard Code and the Tanaka model, in combination with each other for a very simple situation. (See slide 11). The setup we used was a two room building, the room of origin, (a bedroom) and the rest of the house. We considered only one combination fuel package, a bed and two side tables, but with two different sets of materials. In each case, the fire was assumed to start in the middle of the bed. In this hypothetical example, the kind of output we might expect is shown in slide 12. Tenability limits for temperature and visibility were assumed as follows: lower layer room temperature reaches 100°C; and the smoke layer reaches 1m from the floor. Two toxicity tenability limits were assumed a) for all the products of combustion, $30 \times LC_{50}$ mg/l min; and b) for carbon monoxide, 4500 ppm min. For each of the fuel packages, designated A and B, we calculated the conditions which first made each room untenable. What this particular example turned up was that tenable conditions persisted in both the room of origin and the rest of the building with fuel package A. With fuel package B, we did run into tenability limits in very short order.

Visibility happened to be the first one. This occurred in both the room of origin and the rest of the building. The smoke layer came to within one meter of the floor in 4 to 5 minutes. The second limit that was reached was the lower layer temperature in the room of origin reached 100°C in 5 or 6 minutes. Lethal levels of toxicants were not reached in neither of these cases which involved relatively small fuel loadings.

What is our overall plan for hazard assessment in the Center for Fire Research? (See slide 13). It includes research, test method development, experimental studies, particularly in the area of extinguishment systems, an extension to our work in fire modeling and what is more important to you in the audience, the development of models that can be used by the people other than those who develop them. The research effort will include studies such as particulate generation, particulate coagulation, smoldering fires and the combined effects of various toxicants. Work on the development and refinement of test methods will include the rate of generation of combustion products, the rate of heat release, flame spread and refinements to combustion toxicity testing. Not all fires continue unchecked. Fire control systems are effective. So we plan to study the response and effectiveness of extinguishment systems and the effectiveness and field testing of smoke control systems. I have already mentioned that our fire growth modeling will be developed further, particularly the single compartment model where we will address wall fires, forced ventilation, incorporate extinction effects and the use of layered materials on the walls. The multi-room smoke model will be extended to improve prediction of the lower layer temperatures in the various parts of the building, and to handle mixing of the upper and lower layers, scrubbing of combustion products as they flow around the building, and the effectiveness of smoke control systems. That's an ambitious package. It will take quite a long time before all that is complete. However, we intend to develop usable interim models and information for fire hazard assessment. (See slide 14). Some of the more useful techniques that will come out of this program will be cost and loss models, and building egress models. In addition to those tools we'll be developing or gathering basic data such as various fire scenario probabilities, tenability limits, fire properties of the individual materials and assemblies of materials.

In summary, what I've covered today is the work we are planning on the test method itself, some approaches to hazard assessment and an outline of our program for developing useful tools for hazard assessment.

CONTEXT OF ADDITIONAL RESEARCH

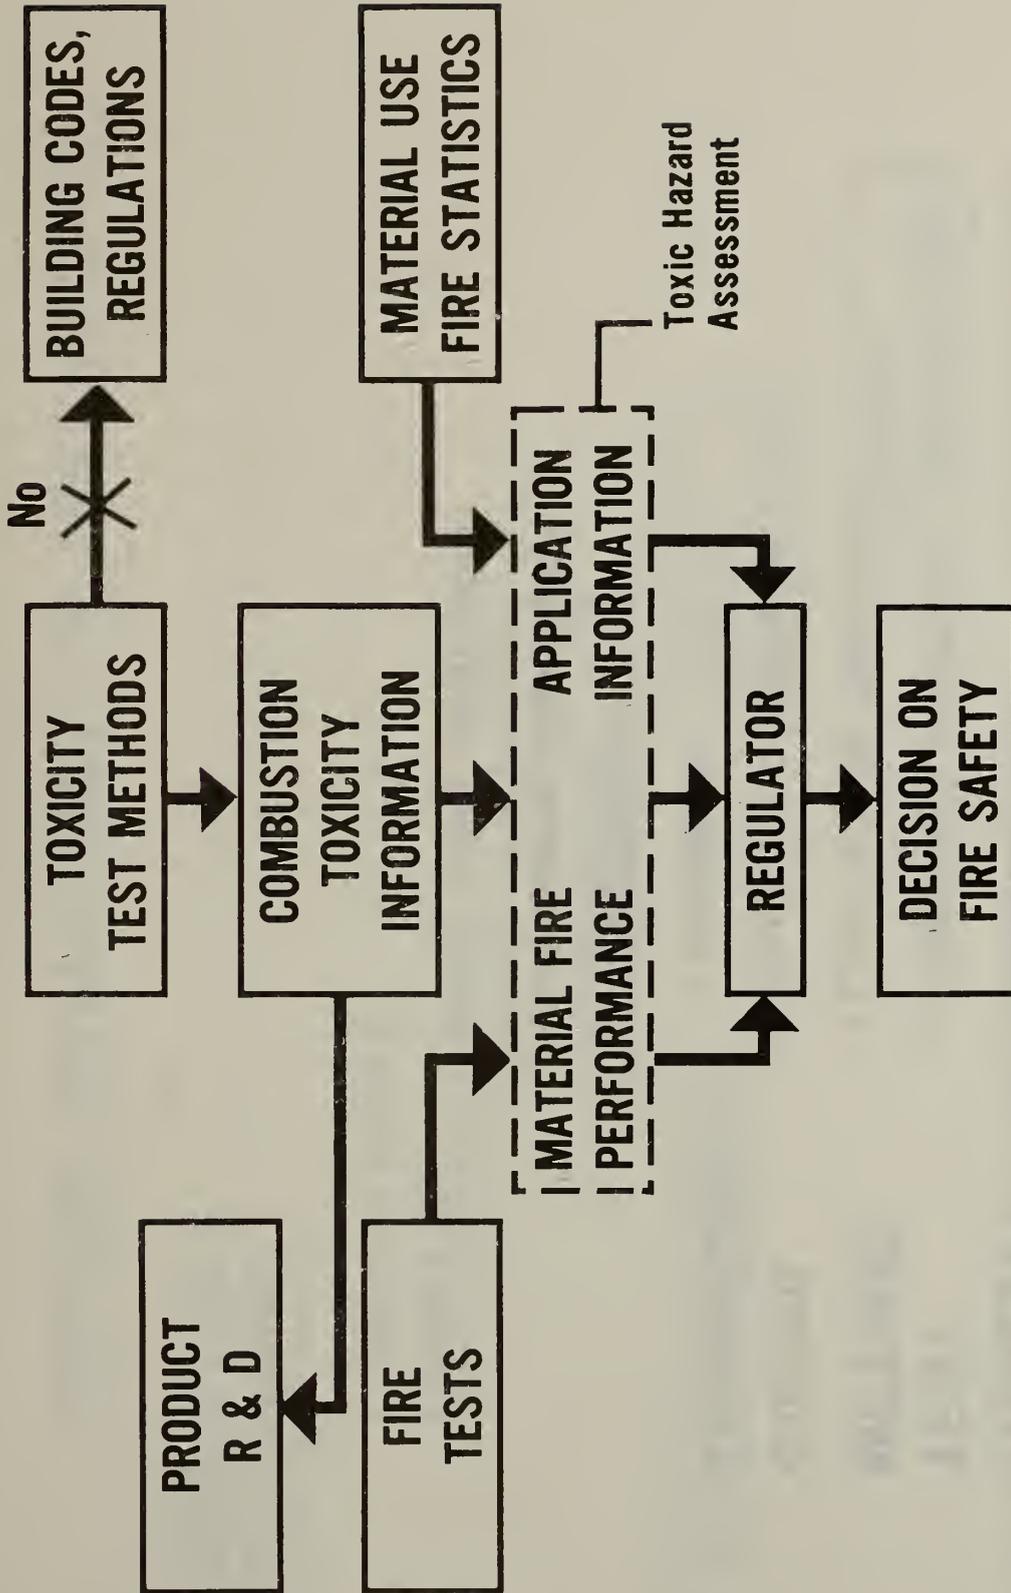


NBS TOXICITY TEST METHOD

Current Limitations

- **No continuous mass loss measurement**
- **Composite materials**
- **Low density materials**
- **Exposure conditions**
 - **Radiation**
 - **Ventilation**
 - **Material orientation**
- **Full scale verification**

FURTHER DEVELOPMENT OF TEST METHOD

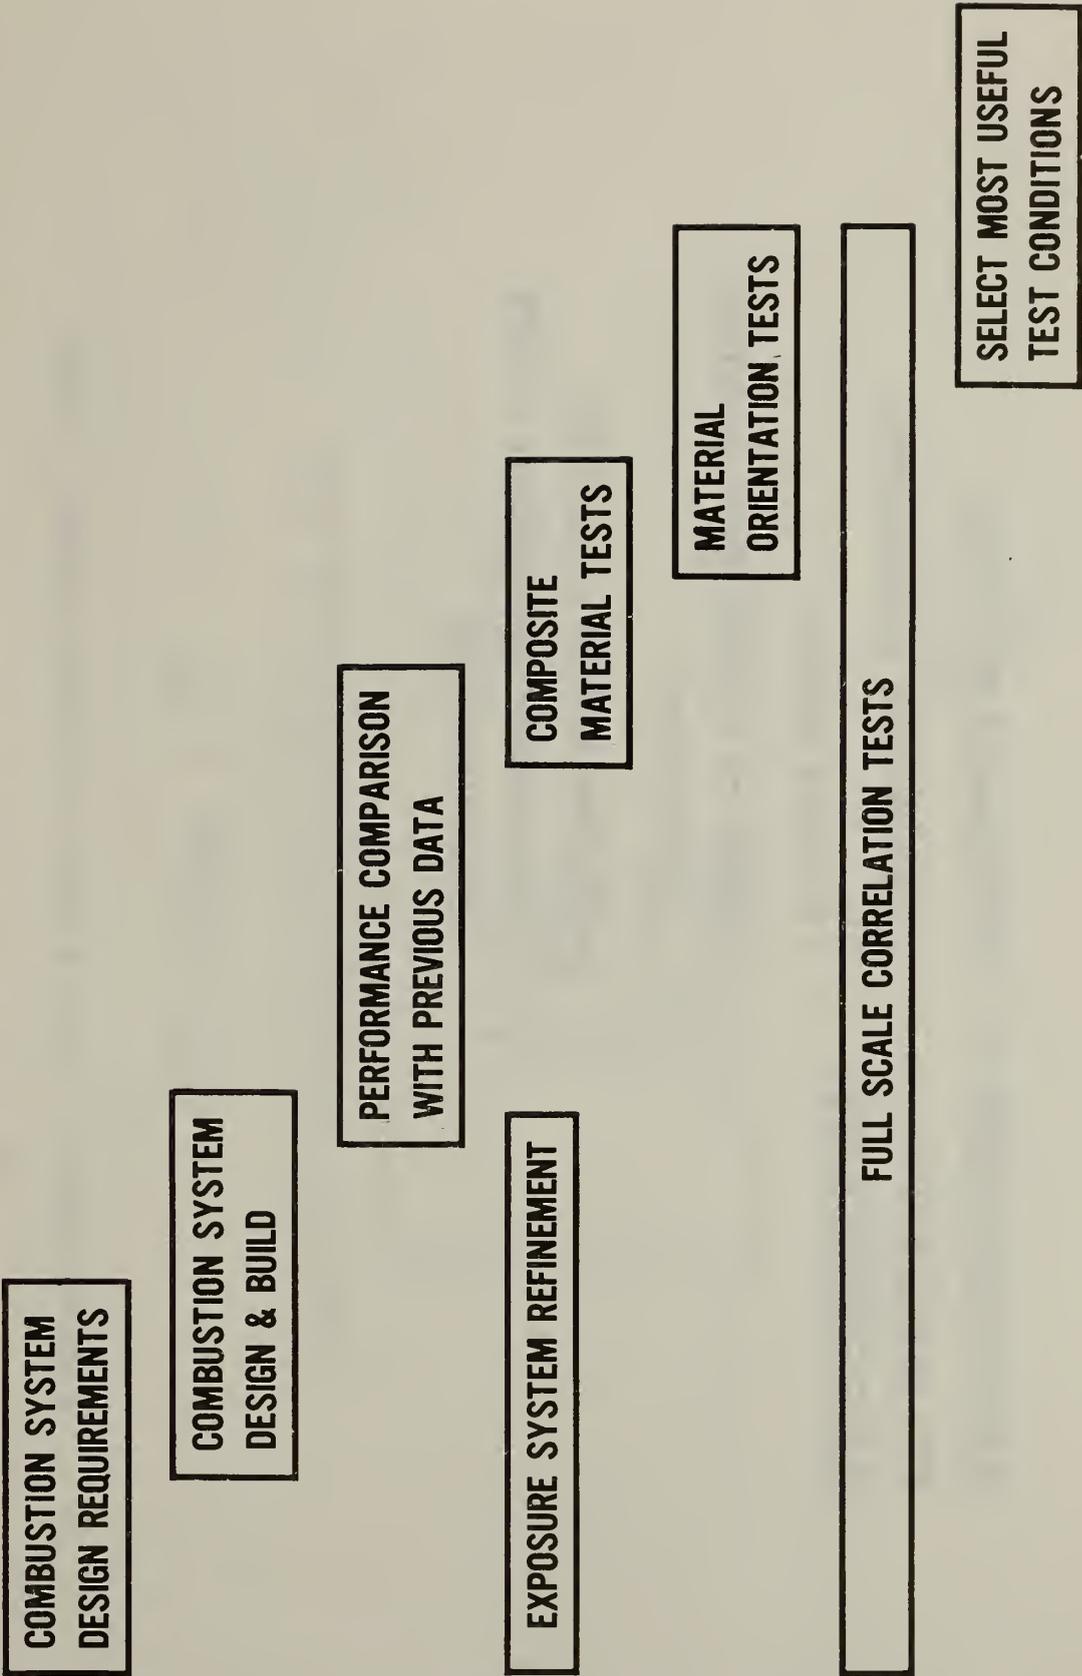

APPROACHES TO HAZARD ASSESSMENT


- **Chemical analysis**
- **Subjective assessment**
- **Hazard index**
- **Rate of combustion product generation**
- **Mathematical modeling (computer prediction of fire environment)**

RATE OF COMBUSTION PRODUCT GENERATION

Lethal dose $D^* = \text{Lethal concentration} \times \text{time}$

$$D^* = LC_{50} \times 30$$

Assume material burning at steady rate

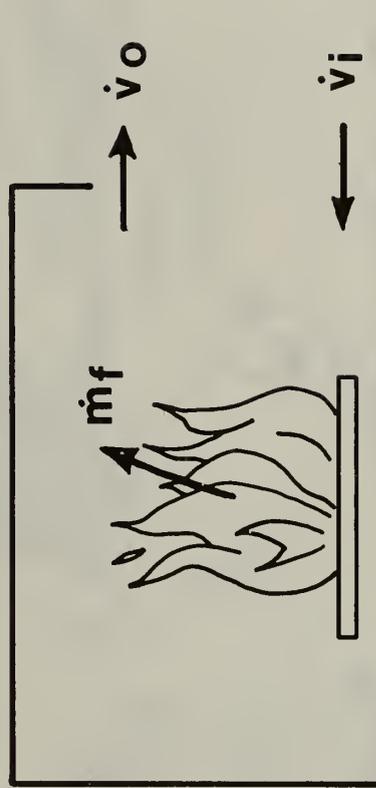


$$\text{Dose} = \frac{\dot{m}_f}{\dot{v}_o} \times \Delta t$$







$$\text{Time to lethal dose } \Delta t^* = \frac{D^* \times \dot{v}_o}{\dot{m}_f}$$

**HAZARD
ASSESSMENT
METHODOLOGY
Fire Modeling**

- Fire growth model (Harvard - single compartment)
- Fire spread model (Tanaka - multi compartment)

Phenomena of Fire Growth

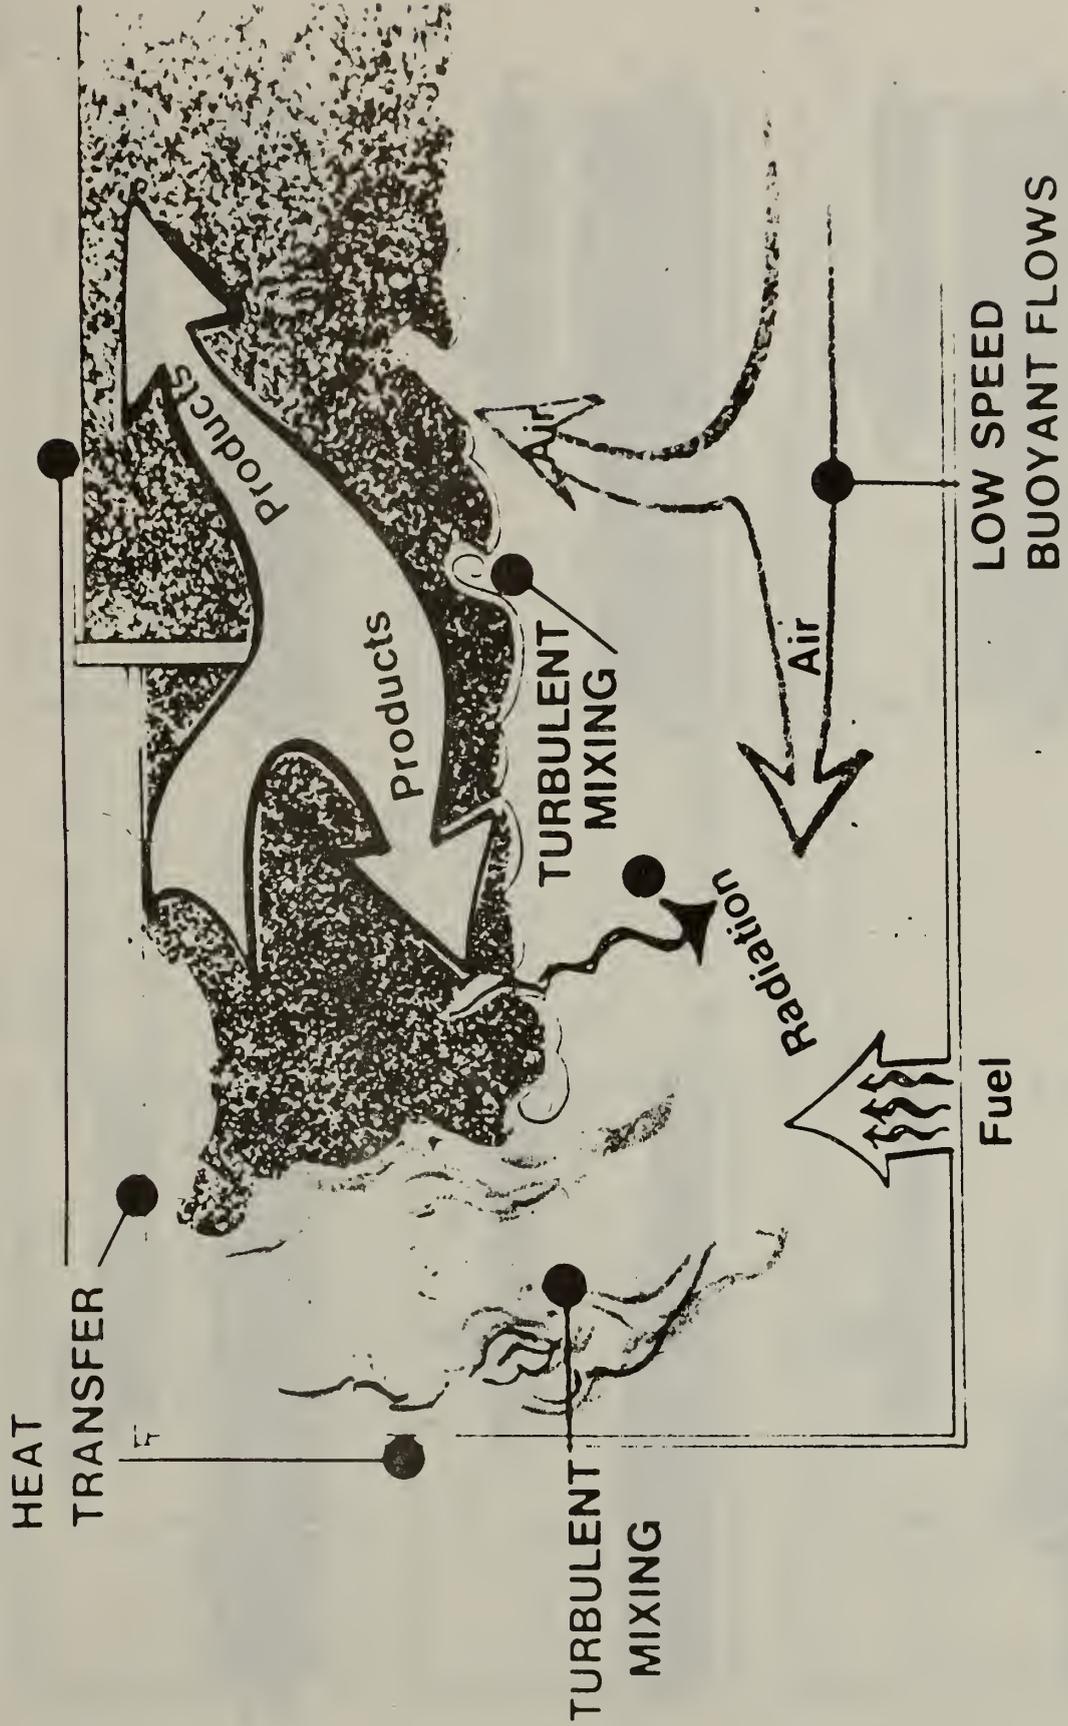

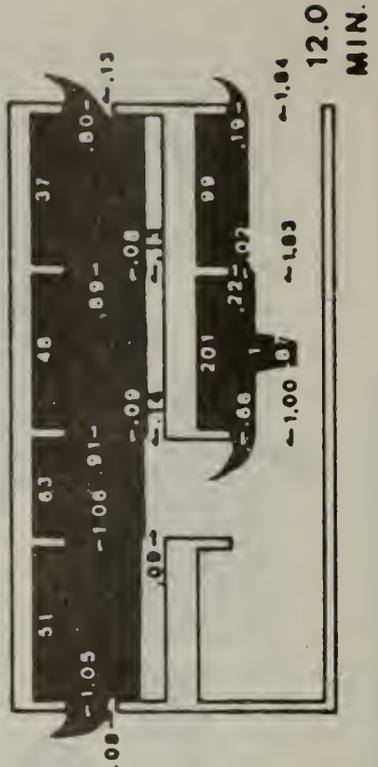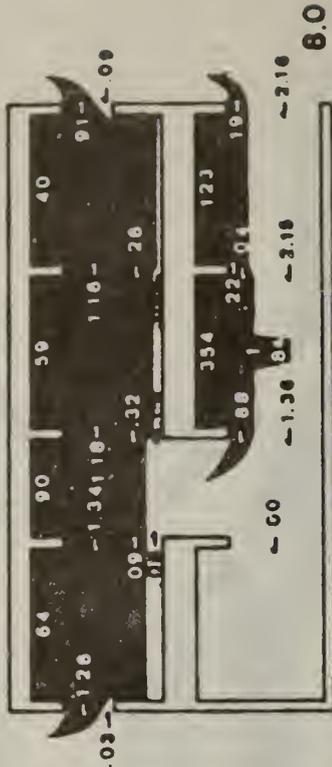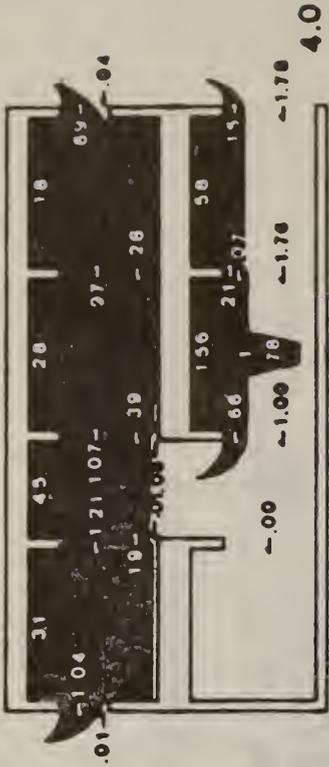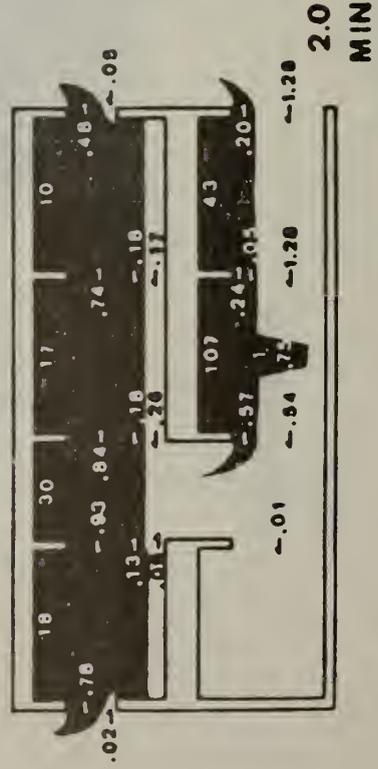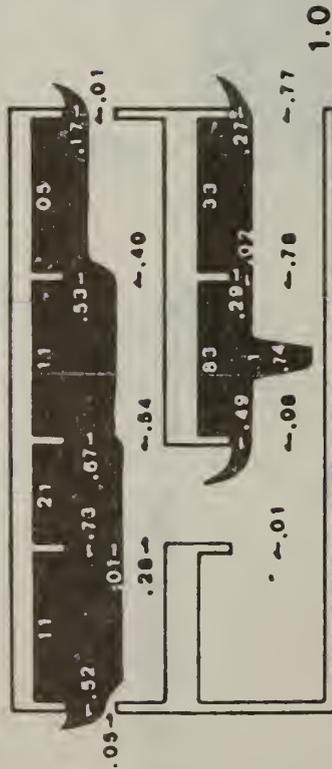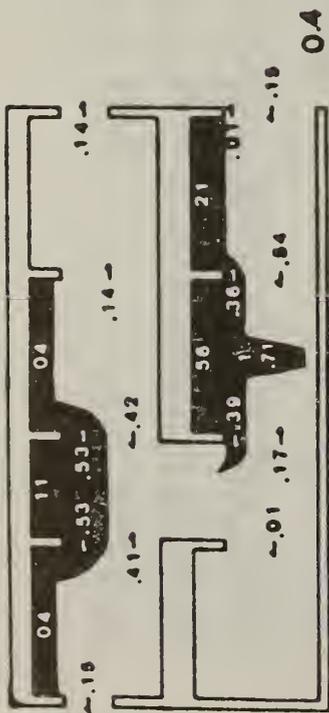

FACTORS ASSOCIATED WITH FIRE HAZARD ASSESSMENT

INPUT

- **Quantity of material**
- **Smoke generation rates**
- **Toxicity data**
- **CO generation rates**
- **Flame spread**
- **Tenability limits**
- **Etc.**


OUTPUT

- **Time to tenability limit**
- **First hazard condition reached
(heat, visibility, toxicity)**

CURRENT LIMITATIONS ON MODELING

- **Lack of input data**
 - **Few materials**
 - **Composites**
 - **Ventilation conditions**
 - **Tenability limits**
- **Models not combined**
- **Forced ventilation not considered**
- **Wall fires not addressed**
- **Efficient computer algorithms**
- **Fire scenario probabilities needed**

ASSUMED FIRE SITUATION

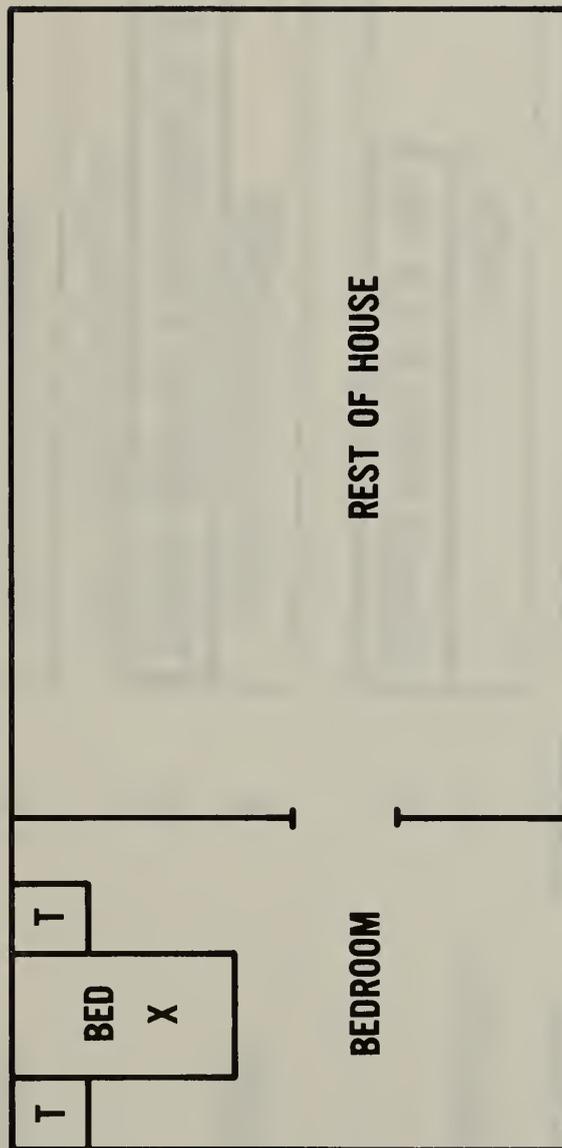

EXAMPLE OF PROPOSED OUTPUT

(hypothetical example)

MATTRESS & SIDETABLES ONLY

<u>Parameter</u>	<u>Materials</u>	<u>Room of Origin</u>	<u>Rest of Building</u>
A. Temperature	A	Tenable	
	B	Exceeds 100°C in 5-6 min.	
B. Visibility	A	Tenable	
	B	Smoke layer w/i 1 m of floor in 4-5 min.	
C. Toxicity	A	Tenable	
	B	(LC50 & CO calculated separately)	

HAZARD ASSESSMENT PLAN

- **Research and test method development**
- **Experimental studies - fire control systems**
- **Fire growth modeling**
- **User models and data for hazard assessment**

USER MODELS AND DATA FOR HAZARD ASSESSMENT

- **Cost/loss models**
- **Building egress models**
- **Fire scenario probabilities**
- **Tenability limits**
- **Material fire property data**
- **Fire properties of assemblies**

- **Combustion product generation
models**

- **Simplified single compartment
and multi-room models**
 - **User guides**
 - **Examples**

APPENDIX

ATTENDANCE LIST

National Bureau of Standards
Workshop on Combustion Product Toxicity
September 10, 1982

Dr. H. (Pat) Adams, Jr.
Technical Director
Man-Made Fiber Producers Assoc.
1150 17th Street, NW.
Washington, D.C. 20036
(202) 296-6508

Mr. Charles W. Almand
Manager, Governmental Services
U.S. Gypsum
1050 17th Street, NW, Suite 1150
Washington, D.C. 20036
(202) 223-8266

Dr. Rosalind C. Anderson
Toxicologist
Arthur D. Little, Inc.
Acorn Park
Cambridge, MA 02140
(617) 864-5770

Mr. Bruce D. Anson
Engineer
Rohm & Haas Company
Independence Mall West
Philadelphia, PA 19107
(215) 592-3644

Mr. Bernard E. Auerbach
Manager, Standards Information
Allied Tube & Conduit Corporation
16100 South Lathrop Avenue
Harvey, IL 60426
(312) 339-1610

Mr. Irwin A. Benjamin
Vice President
Benjamin/Clarke Associates, Inc.
10605 Concord Street
Kensington, MD 20895
(301) 949-1414

Mr. David W. Bensen
Program Manager
Federal Emergency Management Agency
500 C Street, SW.
Washington, D.C. 20472
(202) 287-3874

Mr. Jim Beyreis
Managing Engineer, Fire Protection
Underwriters Laboratories, Inc.
333 Pfingsten Road
Northbrook, IL 60062
(312) 272-8800 (x2301)

Dr. Merritt M. Birky
Director of Research
Foundation for Fire Safety
1700 North Moore Street, Suite 1508
Rosslyn, VA 22209
(703) 276-9222

Mr. Richard G. Bright
Fire Protection Engineer
Consultant
10303 Huron Court
Mt. Airy, MD 21771
(301) 831-9105

Mr. David J. Burkhart
Student-Fire Protection Engineering
University of Maryland
P.O. Box 223
College Park, MD 20740
(301) 434-2400

Mr. Robert W. Burns
Principal Engineer - Fire Protection
State of New Jersey, Bureau of
Construction Code Enforcement
363 West State Street
Trenton, NJ 08625
(609) 292-6254

Dr. Frederic B. Clarke
President
Benjamin/Clarke Associates, Inc.
10605 Concord Street
Kensington, MD 20895
(301) 949-1414

Mr. Eugene T. Cumberland
Codes Enforcement Officer
Codes Administration - Department of
Economic and Community Development
2525 Riva Road
Annapolis, MD 20714
(301) 269-2701

Mr. Alvin D. Delman
 Manager, Testing Services
 The Wool Bureau, Inc.
 225 Crossways Park Drive
 Woodbury, NY 11797
 (516) 364-0890

Mr. Joseph G. DiPinto
 Product Technology Manager
 DuPont Company
 11070 DuPont Building
 Wilmington, DE 19898
 (302) 774-7807

Mr. John C. Drinkard
 Building Code Supervisor
 State of Virginia
 205 North Fourth Street
 Richmond, VA 23219
 (804) 786-5031

Mr. Daniel Drozdowski
 Assistant Vice President
 U.S. Testing Company
 1415 Park Avenue
 Hoboken, NJ 07030
 (201) 792-2400 (x346)

Mr. W. A. Dunlap
 Codes & Standards Specialist
 Dow Chemical Company
 P.O. Box 515
 Granville, OH 43023
 (614) 587-4382

Prof. Irving Einhorn
 Vice President
 Center for Environmental and
 Materials Research
 1550 Asylum Avenue
 West Hartford, CT 06117
 (203) 233-6056

Mr. Wayne P. Ellis
 Manager, Industry Standards
 H. B. Fuller Company
 P.O. Box 625
 Spring House, PA 19438
 (215) 628-2600

Mr. Daniel J. Faingnaert
 Technical Representative - Chemist
 Stauffer Chemical Company
 Grasslands Road
 Elmsford, NY 10523
 (914) 592-9010

Mr. John W. Fothergill, Jr.
 President
 Integrated Systems, Inc.
 P.O. Box 128
 Brunswick, MD 21716
 (301) 834-7117/(703) 734-9057

Ms. Jane N. Fowler
 Administrative Assistant
 Upholstered Furniture Action Council
 918 16th Street, NW., Suite 402
 Washington, D.C. 20006
 (202) 466-7362

Mr. William R. Freeman, Jr.
 Government & Architectural Services
 Koppers Company, Inc.
 11724 Critton Circle
 Woodbridge, VA 22192
 (703) 690-3550

Mr. Kenneth R. Frese
 District Fire Protection Engineer
 Office of State Fire Marshal (Virginia)
 319 Landmark Towers
 101 South Whiting Street
 Alexandria, VA 22304
 (703) 751-1008

Mr. Richard G. Gewain
 Chief Fire Protection Engineer
 American Iron and Steel Institute
 1000 16th Street, NW.
 Washington, D.C. 20036
 (202) 452-7194

Mr. Robert W. Glowinski
 Manager, Fire Technology
 National Forest Products Association
 1619 Massachusetts Avenue, NW.
 Washington, D.C. 20036
 (202) 797-5884

Mr. Tom Goonen
 Senior Engineer
 Schirmer Engineering Corporation
 803 W. Broad Street
 Falls Church, VA 22046
 (703) 237-8211

Ms. Cheryl Grounds
 Student (Fire Protection Engineering)
 University of Maryland
 6864 Riverdale Road, #101
 Lanham, MD 20706
 (301) 577-7851

Mr. Matthew T. Gustafson
 Student (Fire Protection Engineering)
 University of Maryland
 43 Hatton Drive
 Severna Park, MD 21146
 (301) 647-4847

Mr. David M. Hammerman
 Director
 Codes Administration
 2525 Riva Road
 Annapolis, MD 21704
 (301) 269-2701

Ms. Bea Harwood
 Statistician
 U.S. Consumer Product Safety
 Commission
 5401 Westbard Avenue
 Washington, D.C. 20207
 (301) 492-6470

Mr. Marvin Hassman, P.E.
 Director, Materials & Equipment
 Acceptance Division
 Department of Buildings, City of
 New York
 120 Wall Street
 New York, NY 10005
 (212) 248-8817

Mr. Edward Heisnell
 Associate Building Construction
 Engineer
 New York State Housing and Building
 Codes Bureau
 60th Floor, Two World Trade Center
 New York, NY 10047
 (212) 488-4912

Mr. Thomas M. Helscher
 Manager, Regulatory Affairs
 Monsanto Company
 1101 17th Street, NW.
 Washington, DC 20036
 (202) 452-8880

Dr. Robert K. Hinderer
 Senior Toxicologist
 B. F. Goodrich Company
 500 S. Main Street
 Akron, OH 44318
 (216) 374-4534

Mr. Richard N. Hopper
 Director of Governmental Affairs
 Carpet & Rug Institute
 Suite 700, 1629 K Street, NW.
 Washington, D.C. 20006
 (202) 223-2578

Mr. A. Larry Iseminger, Jr.
 Fire Protection Engineer
 Maryland State Fire Marshal's Office
 301 West Preston Street
 Baltimore, MD 21201
 (301) 383-2522

Ms. Deborah Kale
 Statistician
 U.S. Consumer Product Safety
 Commission
 EPHA, Room 642
 Washington, D.C. 20207
 (301) 492-6470

Mr. Richard G. Katz
 Fire Data Analyst
 Federal Emergency Management Agency
 500 C Street, SW.
 Washington, DC 20472
 (202) 287-0766

Mr. David Kay
 Fire Prevention Engineer
 Naval Sea Systems Command
 Code 55X32
 Washington, D.C. 20362
 (202) 692-1242

Mr. Richard P. Kuchnicki
 Executive Director
 Council of American Building Officials
 5205 Leesburg Pike, #1201
 Falls Church, VA 22041
 (703) 931-4533

Mr. Ronald J. Kunego
Foamwall Product Manager
E. G. Smith Division - Cyclops Corp.
100 Walls Street
Pittsburgh, PA 15042
(412) 761-7474 (x234)

Mr. Thomas E. Lewis
Manager, Govt. Tech. & Mkt. Services
Armstrong World Industries, Inc.
1025 Connecticut Ave., NW., Suite 1007
Washington, D.C. 20036
(202) 296-2830

Mr. Larry Litchfield
Deputy Chief Engineer
State of Wisconsin DILHR
Safety & Buildings Division
201 E. Washington Avenue
Madison, WI 53707
(608) 266-0675

Mr. George E. Maloney
Senior Engineering Consultant
The Travelers Insurance Company
7617 Little River Turnpike
Annandale, VA 22003
(703) 750-4196

Mr. Francis A. McGarry
State Fire Administrator
N.Y.S. Office of Fire Prevention
162 Washington Avenue
Albany, NY 12231
(518) 473-3590

Mr. Lawrence A. McKenna, Jr.
Student (Fire Protection Engineering)
University of Maryland
11930 Beltsville Drive, #14
Beltsville, MD 20705
(301) 572-2471

Mr. Don Moore
Architect
HUD
451 7th Street, SW.
Washington, D.C. 20410
(202) 755-6590

Mr. G. R. Munger
President
Society of the Plastics Industry, Inc.
355 Lexington Avenue
New York, NY 10017
(212) 573-9440

Mr. John Munno
Student (Fire Protection Engineering)
University of Maryland
4606 Beechwood Road
College Park, MD 20740
(301) 454-2436

Ms. Margaret L. Neily
Chief, Flammability & Textiles Branch
Engineering Sciences
Consumer Product Safety Commission
Room 735, WTB
Washington, D.C. 20207
(301) 492-6494

Dr. Rita Orzel
Chief, Toxicology Review Branch
Directorate for Health Sciences
Consumer Product Safety Commission
5401 Westbard Avenue
Bethesda, MD 20207
(301) 492-6994

Mr. Robert Robins
Chief Engineer
Hardwood Plywood Manufacturer's Assoc.
P.O. Box 2789
Reston, VA 22090
(703) 435-2900

Mr. H. J. Roux
Coordinating Manager
Armstrong World Industries, Inc.
Lancaster, PA 17604
(717) 397-0611

Mr. Van M. Seabaugh
Toxicologist
Consumer Product Safety Commission
200 C street, SW.
Washington, D.C. 20204
(202) 245-1445

Dr. L. J. Sharman
Fire Programs Officer
Consumer Product Safety Commission
5401 Westbard Avenue
Bethesda, MD 20207
(301) 492-4554

Mr. Tony Shaw
 Manager of Technical Information
 Hoechst Fibers Industries
 P.O. Box 5887
 Spartanburg, SC 29304
 (803) 579-5382

Mr. Robert S. Strength
 Product Safety & Acceptability Manager
 Monsanto Plastics & Resins Company
 800 N. Lindbergh Blvd.
 St. Louis, MO 63167
 (314) 694-3211

Mr. Hugh Patrick Toner
 Society of the Plastics Industry, Inc.
 355 Lexington Avenue
 New York, NY 10017
 (212) 573-9422

Mr. H. F. Van Der Voort
 Vice President, Industry Affairs
 Carlon
 23200 Chagrin Blvd.
 Cleveland, OH 44122
 (216) 831-4000

Mr. William Wald
 General Manager, Marketing
 Tech. Services
 Burlington Industries
 Valley Forge Corp. Center
 King of Prussia, PA 19406
 (215) 666-7770

Mr. Robert E. Warr
 Consultant - Standards
 General Electric
 Fairfield, CT 06431
 (203) 373-2288

Mr. Rodney L. Wells
 Research Specialist, Polymer
 Technology
 Allied Corporation
 P.O. Box 31
 Petersburg, VA 23804
 (804) 520-3621

Mr. Joseph G. Werner
 Vice President
 National Electrical Manufacturers Assoc.
 2101 L. Street, NW.
 Washington, D.C. 20037
 (202) 457-8444

Mr. Franklin E. Williams
 Division Lab. Manager
 Burlington Industries
 Anderson Street
 Glasgow, VA 24555
 (703) 258-2811

Mrs. Susan Womble
 Chemist
 Consumer Product Safety Commission
 5401 Westbard Avenue
 Bethesda, MD 20207
 (301) 492-6994

Mr. Raymond S. Zielinski
 Code Enforcement Specialist
 N.Y.S. Office of Fire Prevention & Control
 162 Washington Avenue
 Albany, NY 12231
 (518) 474-6746

U.S. DEPT. OF COMM. BIBLIOGRAPHIC DATA SHEET <i>(See instructions)</i>	1. PUBLICATION OR REPORT NO. NBSIR 82-2634	2. Performing Organ. Report No.	3. Publication Date
4. TITLE AND SUBTITLE Workshop on Combustion Product Toxicity Summary of Presentations, September 10, 1982			
5. AUTHOR(S) Jack E. Snell, Barbara C. Levin, Andrew J. Fowell			
6. PERFORMING ORGANIZATION <i>(If joint or other than NBS, see instructions)</i> NATIONAL BUREAU OF STANDARDS DEPARTMENT OF COMMERCE WASHINGTON, D.C. 20234		7. Contract/Grant No.	8. Type of Report & Period Covered
9. SPONSORING ORGANIZATION NAME AND COMPLETE ADDRESS <i>(Street, City, State, ZIP)</i>			
10. SUPPLEMENTARY NOTES <input type="checkbox"/> Document describes a computer program; SF-185, FIPS Software Summary, is attached.			
11. ABSTRACT <i>(A 200-word or less factual summary of most significant information. If document includes a significant bibliography or literature survey, mention it here)</i> This publication is a summary of presentations given September 10, 1982, at a Workshop on Combustion Product Toxicity. Publicity on fire deaths caused by smoke and toxic gases has given impetus to a number of state legislatures to consider requiring material toxicity provisions in building codes and other regulations. The National Bureau of Standards recently published a technical report describing the development of a test method for the assessment of the acute inhalation toxicity of combustion products. This test method is intended primarily for research and for preliminary screening purposes by product researchers and material manufacturers in developing and evaluating materials. The test method is not intended to be used itself in evaluating the suitability of a material for specific application since additional factors must be considered. Therefore, the National Bureau of Standards sponsored a half-day workshop on combustion product toxicity, 9:00 a.m. - 12:00 noon, Friday, September 10, 1982, at NBS in Gaithersburg, Maryland. The purpose of this meeting was to brief fire code and building officials and others on the NBS test method for assessing acute inhalation toxicity of combustion products and to provide an opportunity for discussion of its appropriate use.			
12. KEY WORDS <i>(Six to twelve entries; alphabetical order; capitalize only proper names; and separate key words by semicolons)</i> building codes; combustion products; fire growth modeling; hazard assessment; inhalation; materials; test method; toxicity.			
13. AVAILABILITY <input checked="" type="checkbox"/> Unlimited <input type="checkbox"/> For Official Distribution. Do Not Release to NTIS <input type="checkbox"/> Order From Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402. <input checked="" type="checkbox"/> Order From National Technical Information Service (NTIS), Springfield, VA. 22161		14. NO. OF PRINTED PAGES 65	15. Price \$9.00

